

THERMAL MASS IN BUILDINGS AND ENERGY FLEXIBILITY

Jérôme LE DRÉAU
jld@civil.aau.dk



Per HEISELBERG
ph@civil.aau.dk

CITIES project (19/08/2015)
WP 3 - Intelligent Energy System Integration


Scope and Objectives

Scope: space heating for residential applications with storage in the thermal mass of the building

Objectives: quantify the flexibility of different terminals for heating

- Storage
- Heat release

Building stock

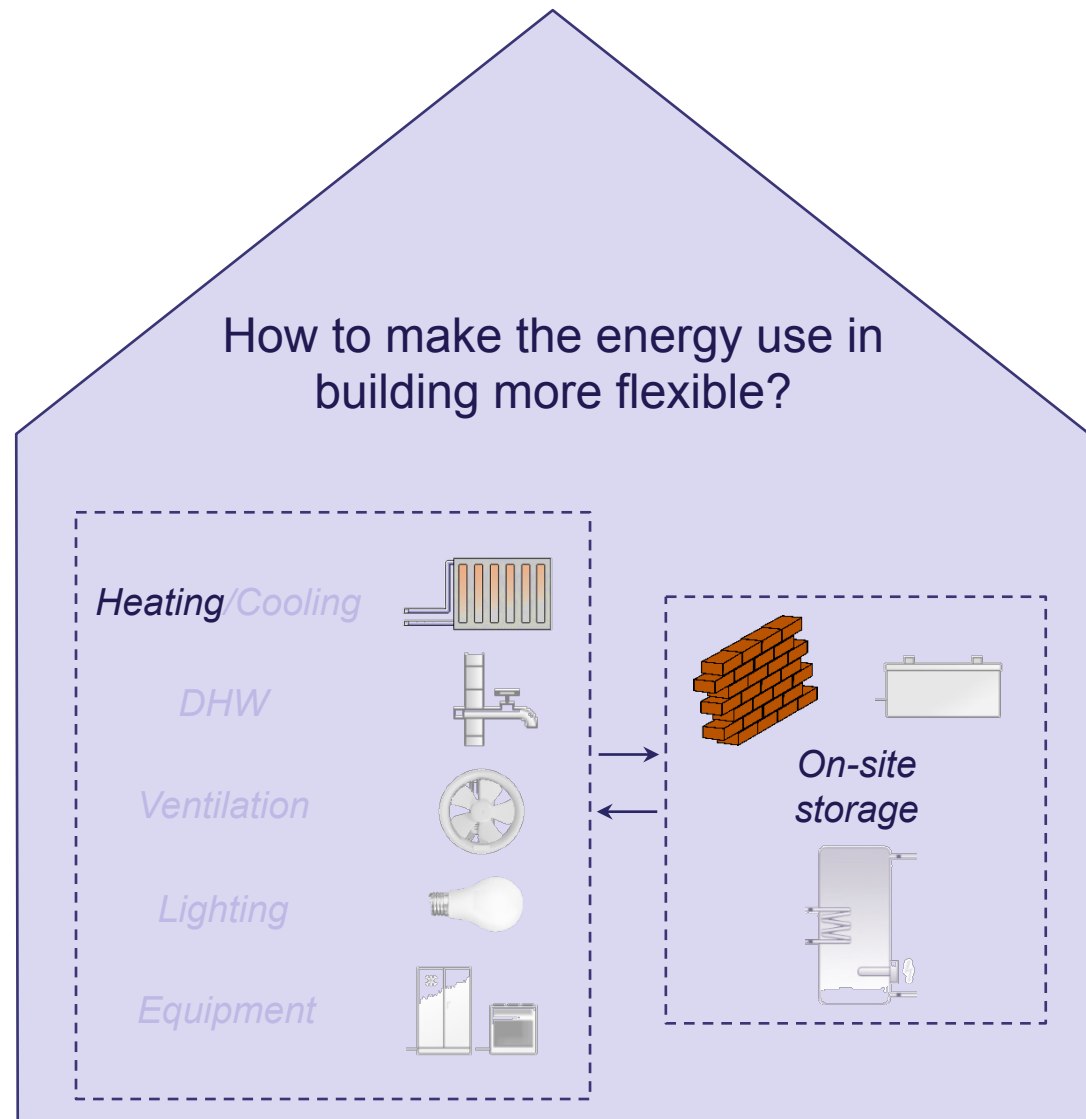


Parameter variation



Type of buildings



Type of emitters

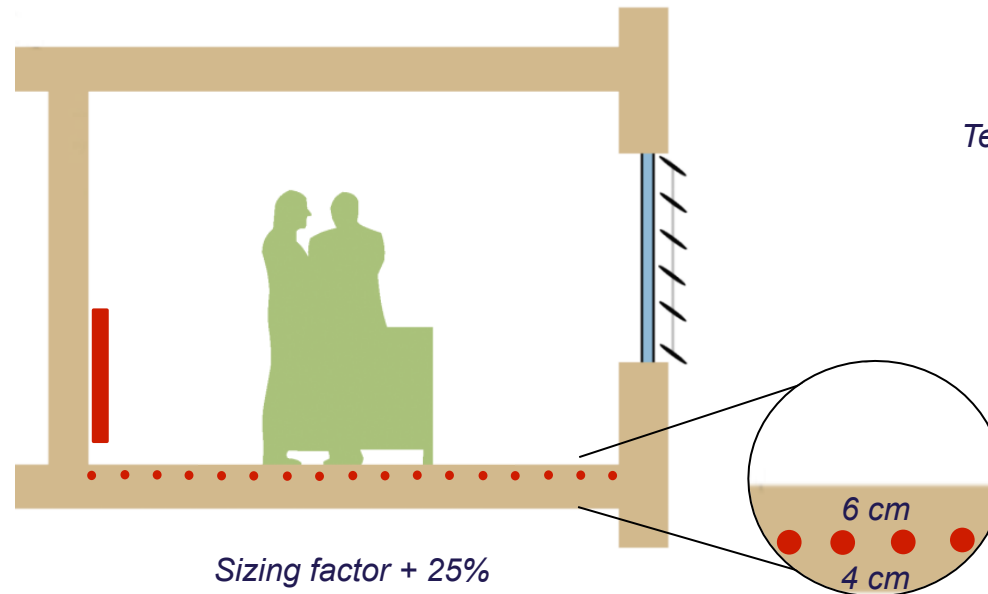

Type of activation
(duration, starting time,
increase vs. decrease)

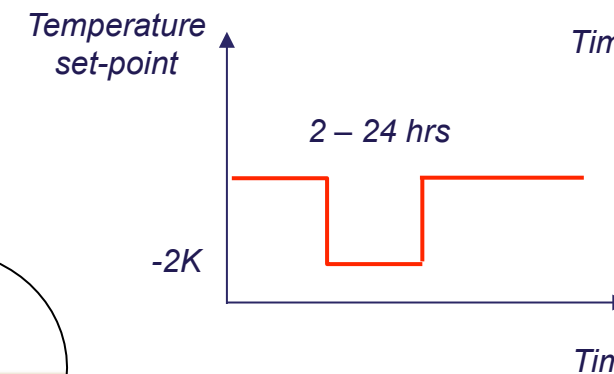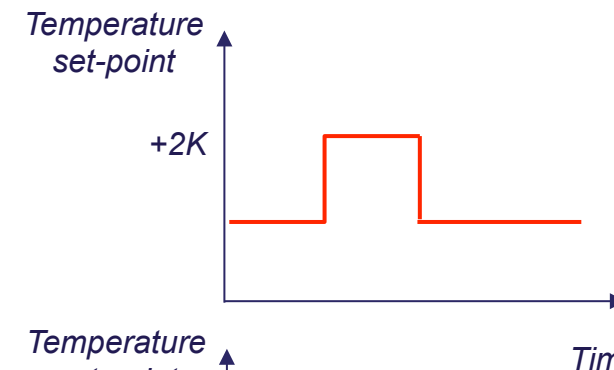

Simulations



Coupled with BCVT

Main characteristics:

- Danish weather file (DRY.v2)
- Equipment load from hourly pattern (*Marszal et al., 2015*)
- 8 thermal zones
- Solver: time-step 2 minutes, conduction modelled using FDM

Simulation procedure:

- Single activation at different time of the year
- No interaction between activations (i.e. full discharge)

Set-point



× 365
activations



$$U_{\text{walls}} = 0.32 \text{ W/m}^2\cdot\text{K}$$

Natural ventilation 0.4 ACH

Infiltration 0.2 ACH

Thermal mass: light (44 Wh/K.m²)

$\tau = 27 \text{ hrs}$

Heating set-point: 20°C

Design power: 70 W/m²

Primary water tmp: 70°C radiator, 43°C UH



$$U_{\text{walls}} = 0.09 \text{ W/m}^2\cdot\text{K}$$

Mechanical ventilation 0.4 ACH ($\eta = 0.8$)

Infiltration 0.07 ACH

Thermal mass: medium (53 Wh/K.m²)

$\tau = 105 \text{ hrs}$

Heating set-point: 21°C

Design power: 25 W/m²

Primary water tmp: 45°C radiator, 30°C UH





SINGLE FAMILY HOUSE FROM THE 80'S





AALBORG UNIVERSITY
DENMARK

Radiator [15th of January]

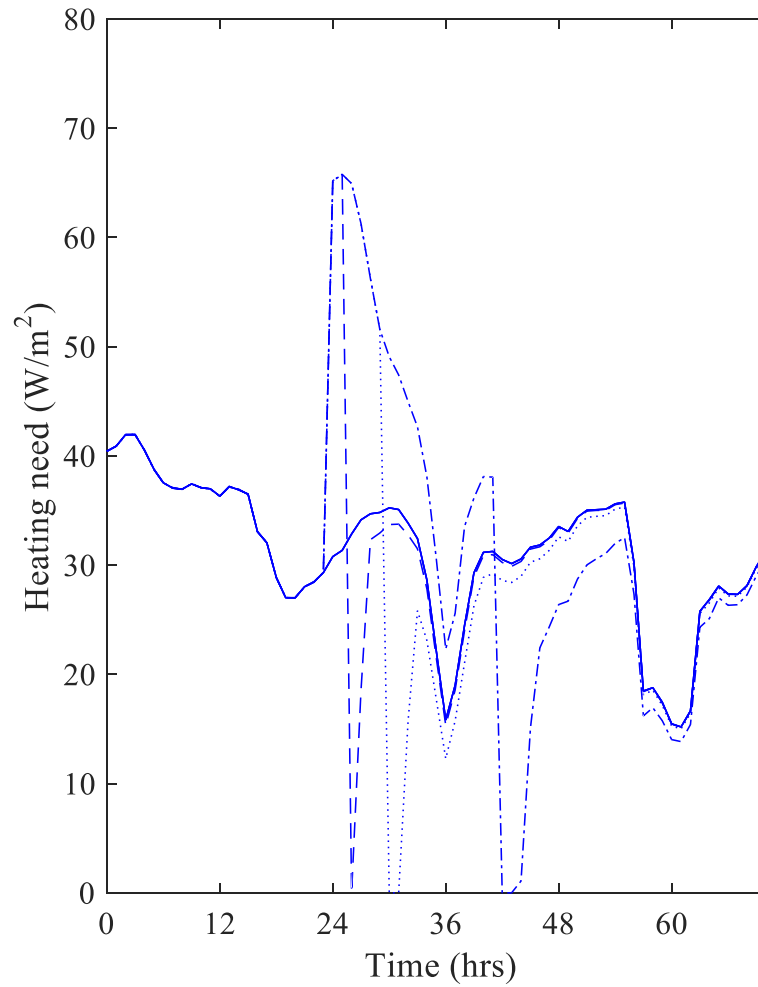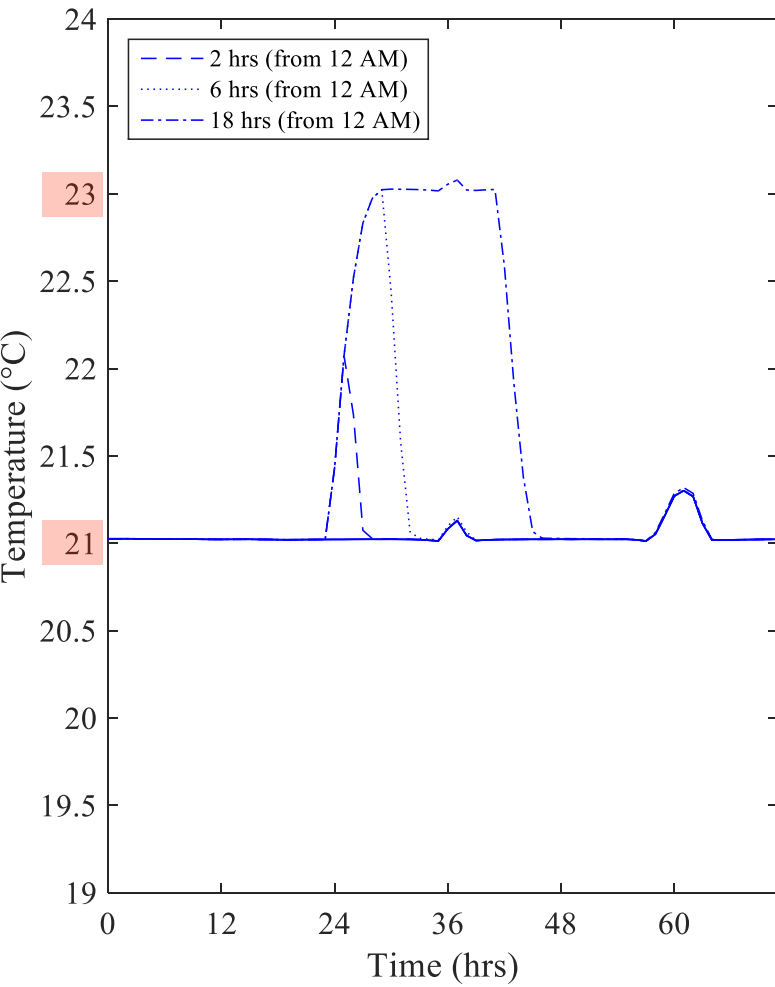




- Large influence on indoor temperature
- Small potential for disconnection

Underfloor heating (UH) [15th of January]

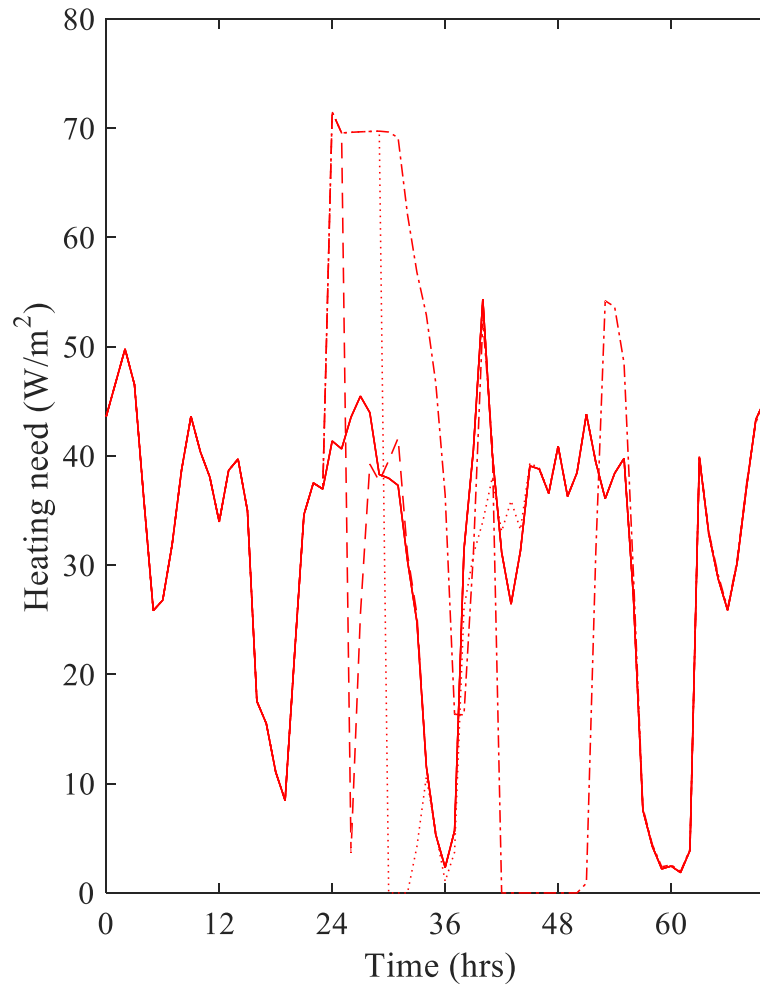
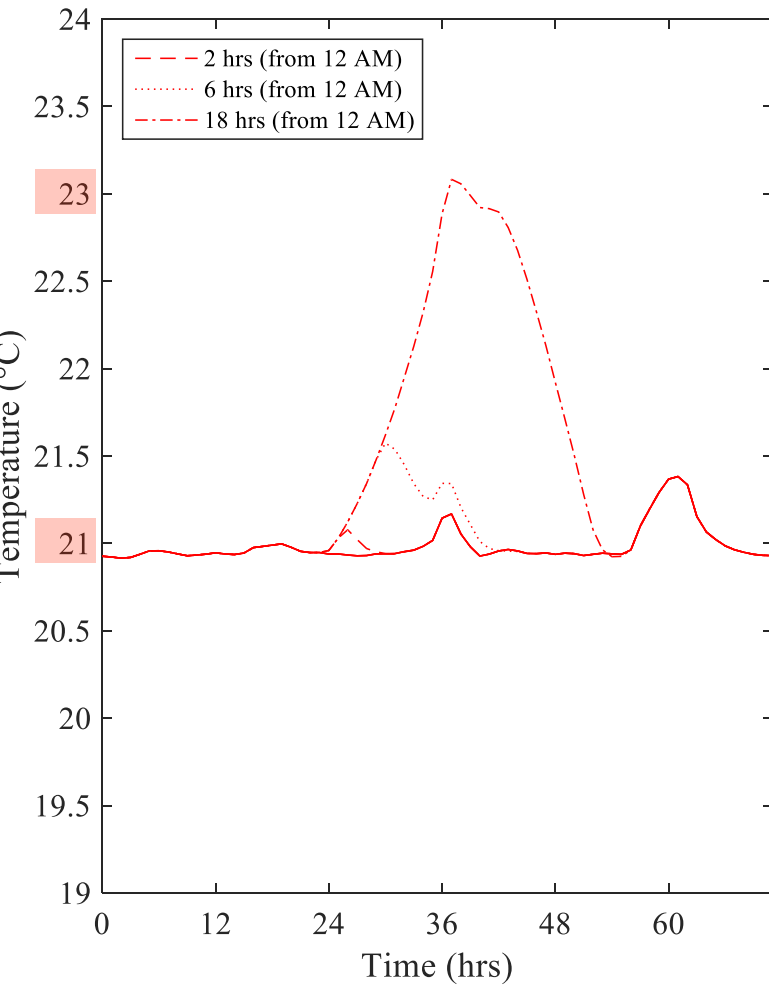


- Lower influence on indoor temperature short charges

Analyse of the results

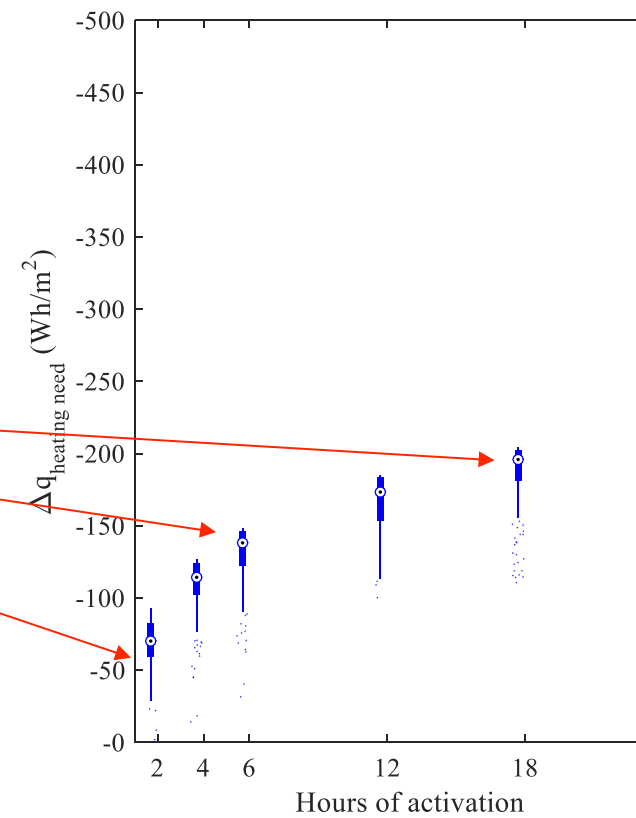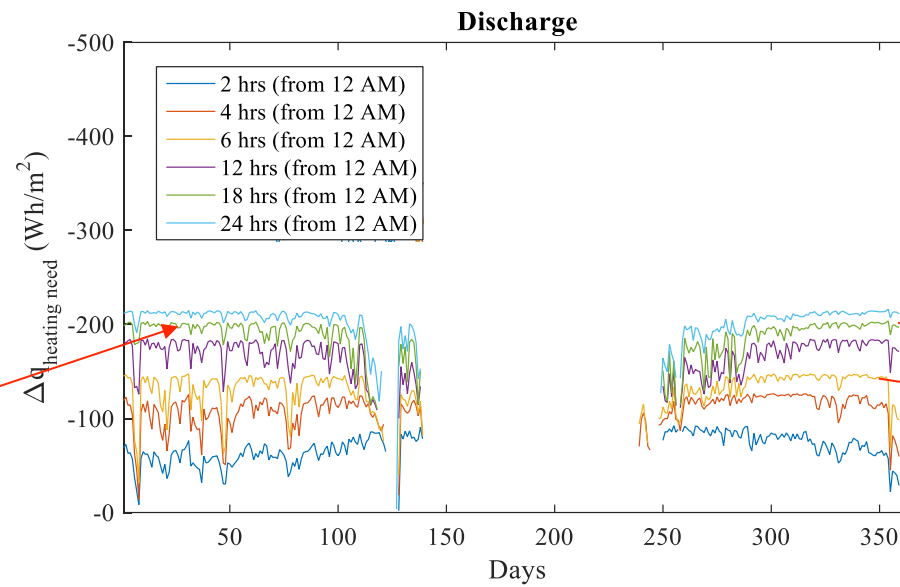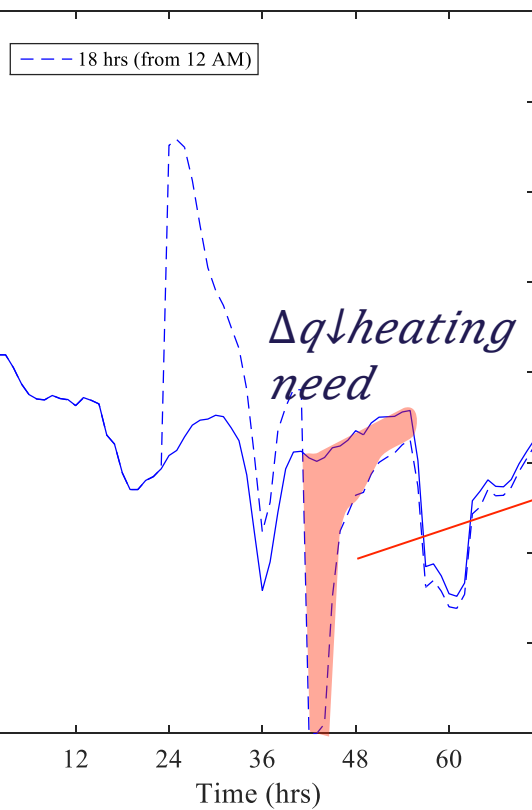

Radiator vs. Underfloor heating *[All days of heating season]*

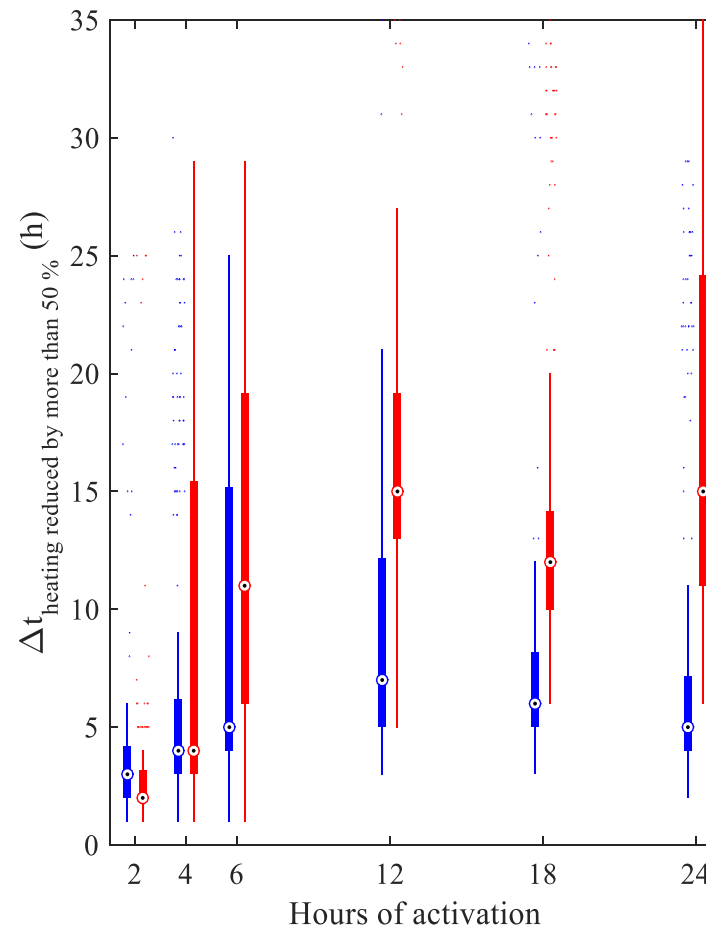
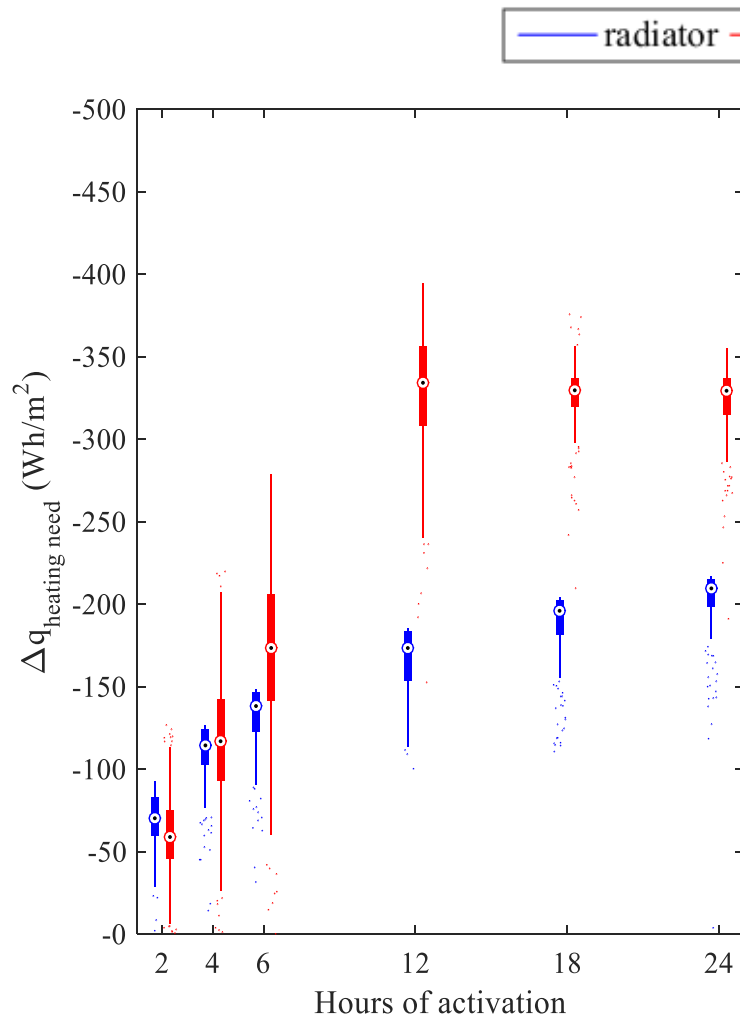


- Larger charging potential of UH, but of overheating
- Nbr of hours of decreased charge of the grid:
 - 2-5 hrs for radiator
 - 2-15 hrs for UH
 but large fluctuations

Radiator vs. Underfloor heating [15th of January]





— radiator — underfloor heating

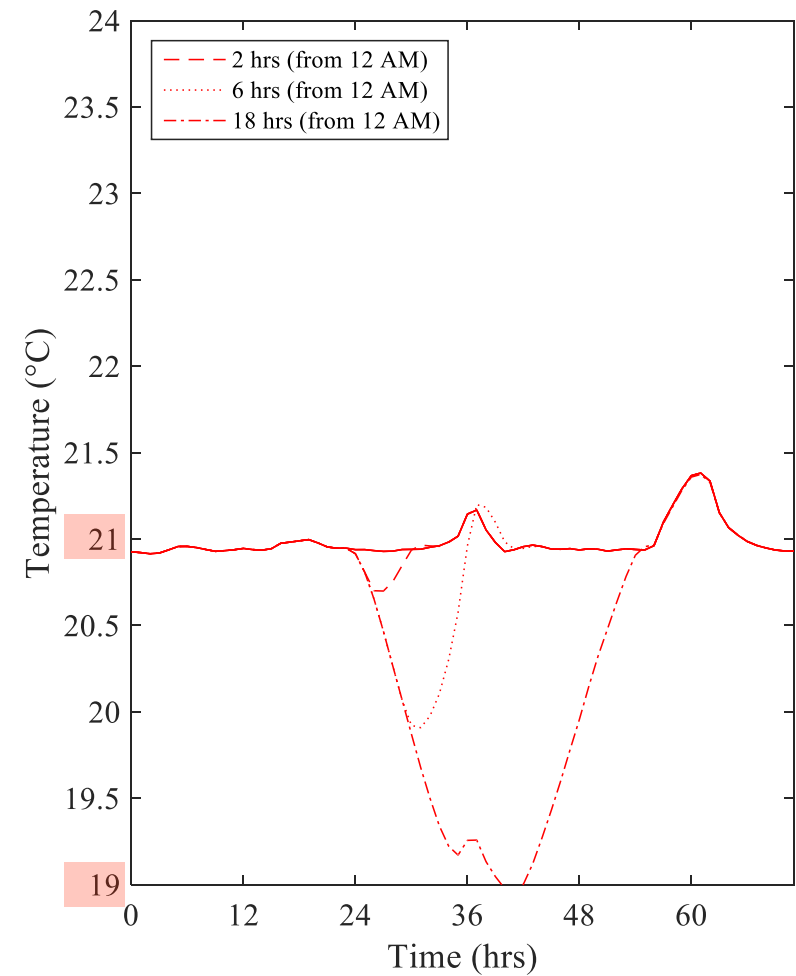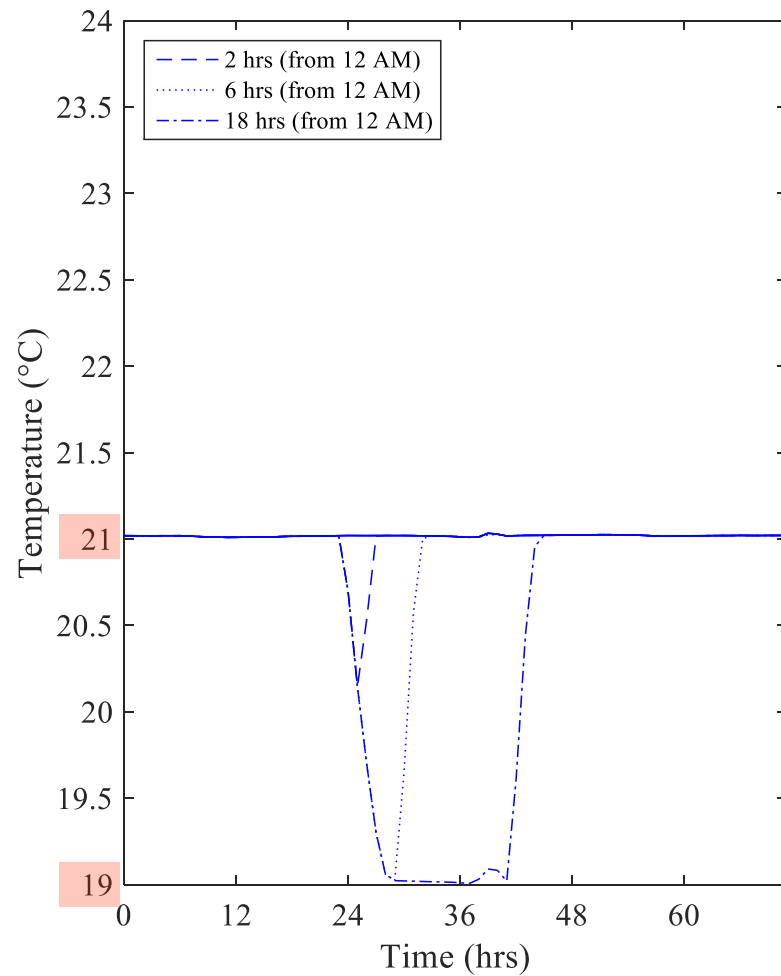

Radiator vs. Underfloor heating [Summary]




— radiator — underfloor heating

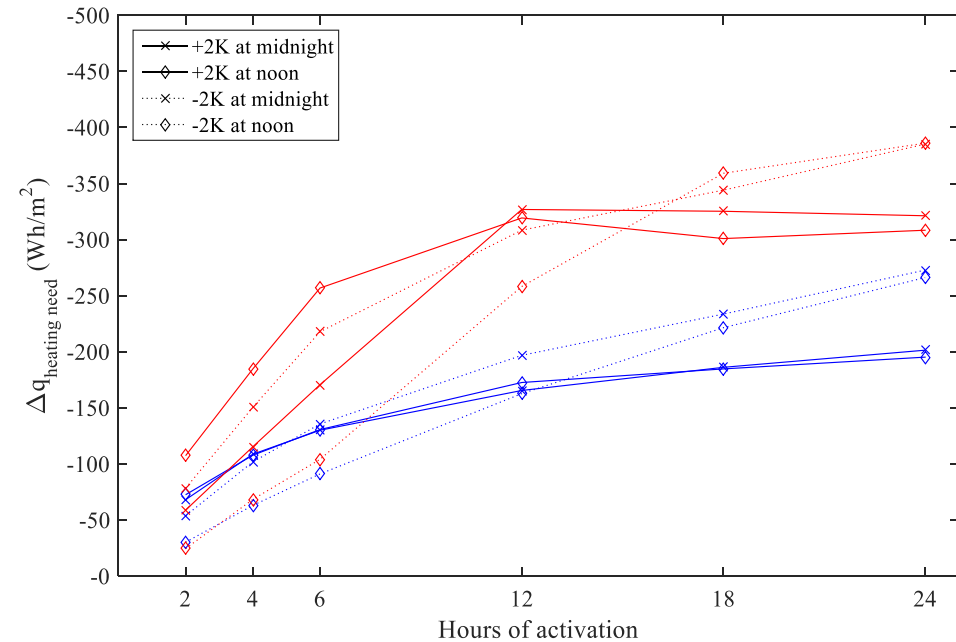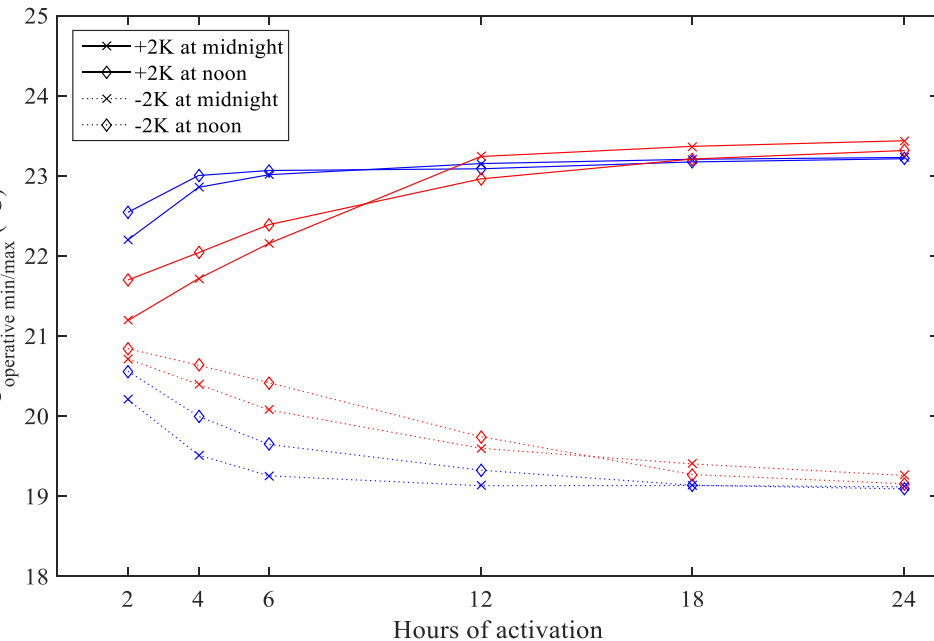

- UH disturbs less the indoor environment
- Charges/Discharges over 12 hrs not efficient
- Optimum solutions: increase of SP during daytime OR decrease during nighttime


PASSIVE HOUSE

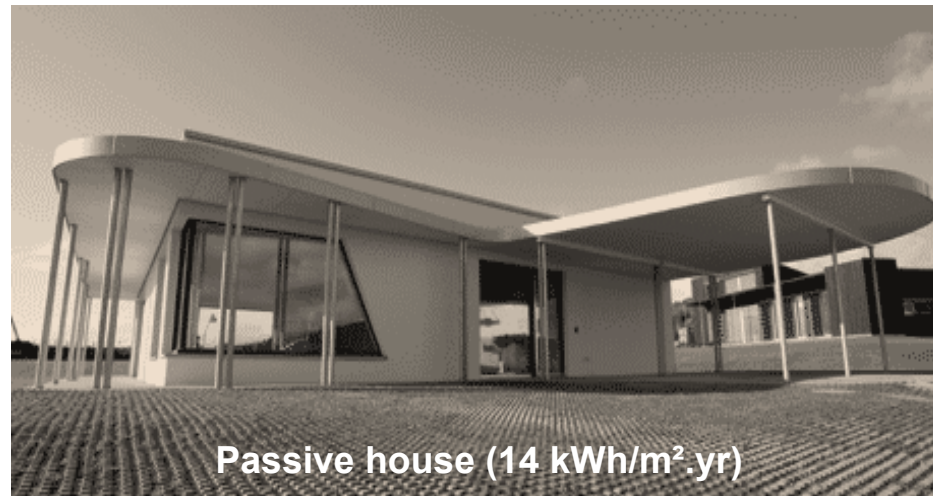

AALBORG UNIVERSITY
DENMARK




Radiator vs. Underfloor heating [Summary]

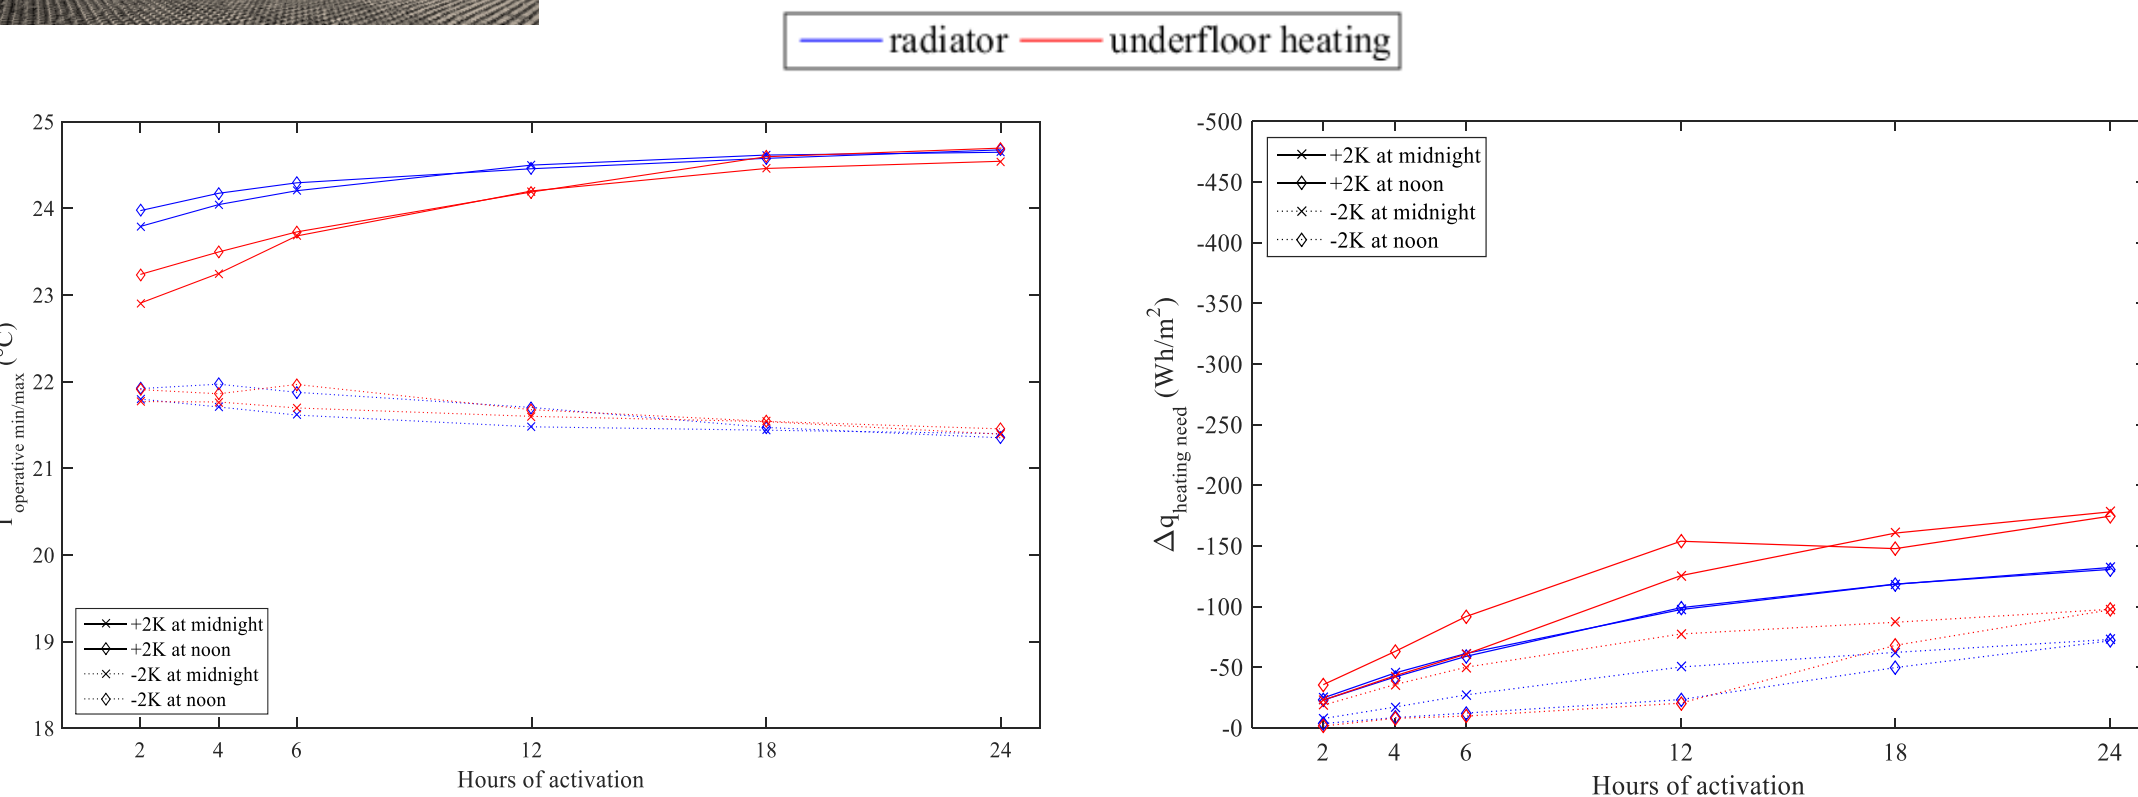

- Asymmetry between heat storage and heat conservation strategy
- Increase of SP: large storage potential, but large risk of overheating
- Decrease of SP: good storage potential if performed during nighttime, low discomfort



Radiator vs. Underfloor heating [Summary]

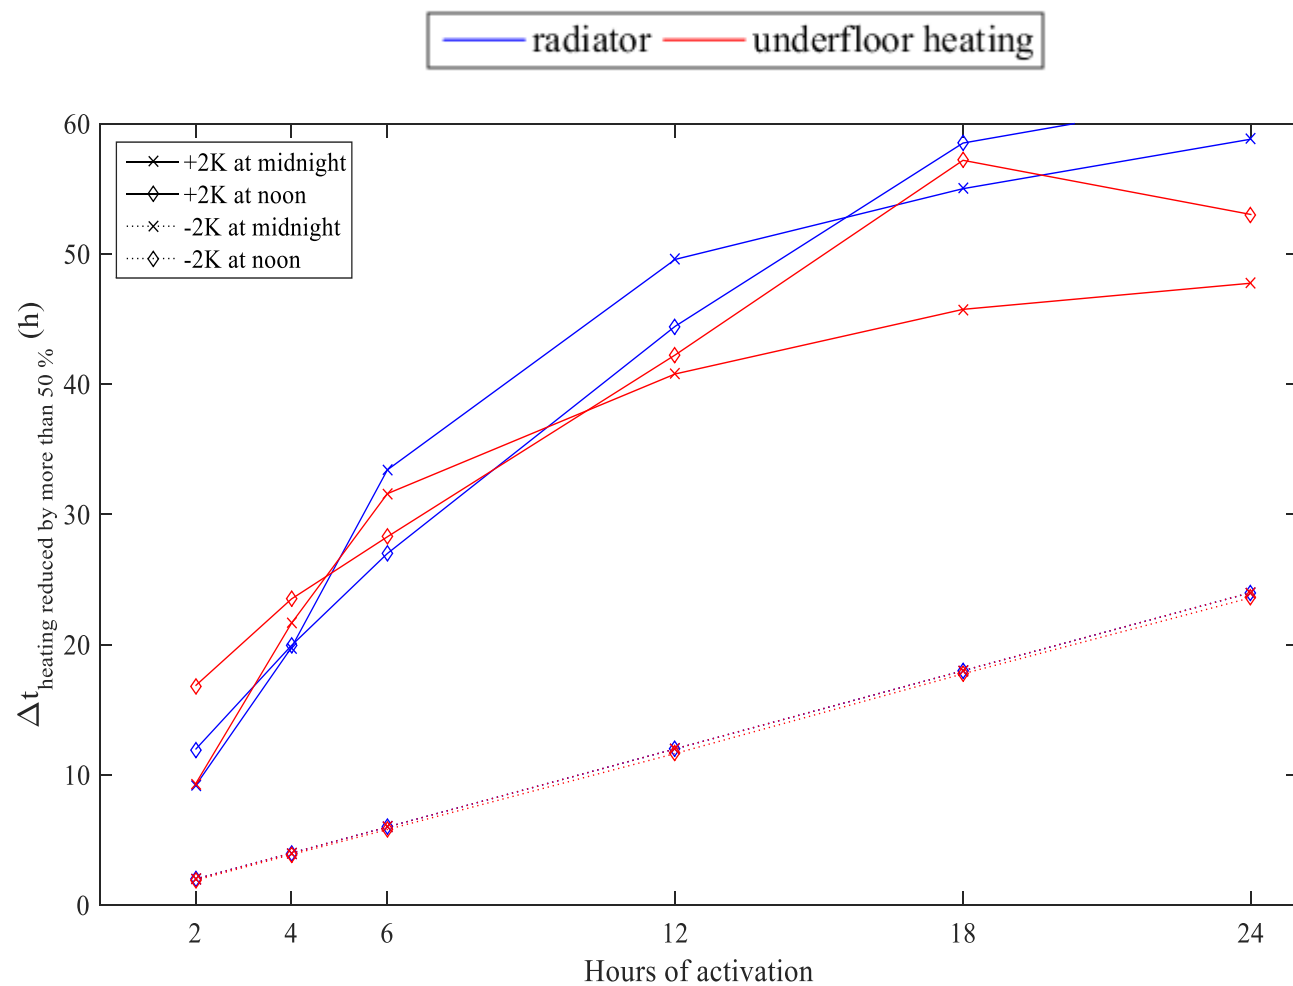

- Possibility to fully disconnect the building for more than 24 hs
- Increase of set-points: up to 3 days

Conclusions



“Optimum” solutions for the SFH from the 80’s:

- UH activated up to 6-12 hours, for an effect during a few hours
Increase of set-point during daytime, or a decrease of set-point during night-time
- Radiator: only for short charges or discharges (2 to 4 hours), low efficiency

“Optimum” solutions for the Passive House:

- UH or Radiator, in discharge only
Decrease of set-point during night-time
- UH with short charges (2-4 hours)... but high risk of overheating if no MPC!

Both buildings seem to be more flexible with a PV-based grid (day/night asymmetry).



Future work

- Apply these strategies to existing grid prices and profile, and identify the possible savings.

		SFH 80's	PH
Underfloor heating	Yearly cost without activation		
	Activation 1		
	Activation 2		
Radiator	Yearly cost without activation		
	Activation 1		
	Activation 2		

- 1 grid scen
- Too rough?

- OR study multi-storey buildings, with higher time constant

Lessons learned from the simulations



- Calculation of conduction through walls:
 - More influence than for “regular” simulations (faster activations)
 - Settings: importance of the time-step + type of solver (CTF vs. FDM)
 - Simplified models (i.e. RC models) will probably be difficult to define
- Sizing of heating systems is very important
- One pending question: what is the influence of the controller?
 - Radiator: default “perfect” controller
 - Underfloor heating: P-band setting \Rightarrow the heating need would be more constant with a PI controller



AALBORG UNIVERSITY
DENMARK





Radiator vs. Underfloor heating [15th of January]

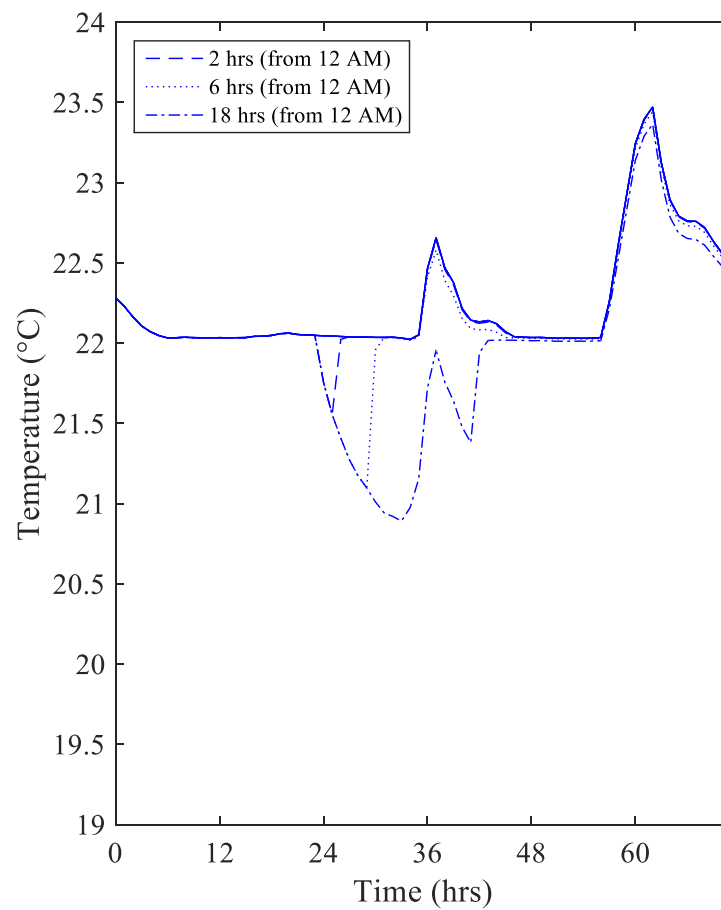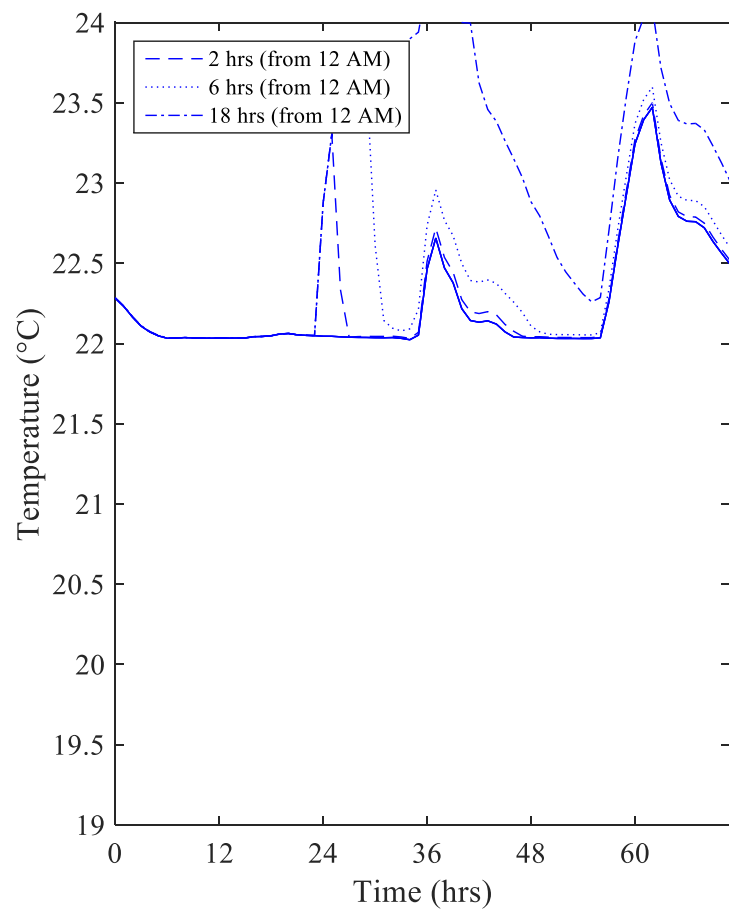



Radiator vs. Underfloor heating [15th of January]

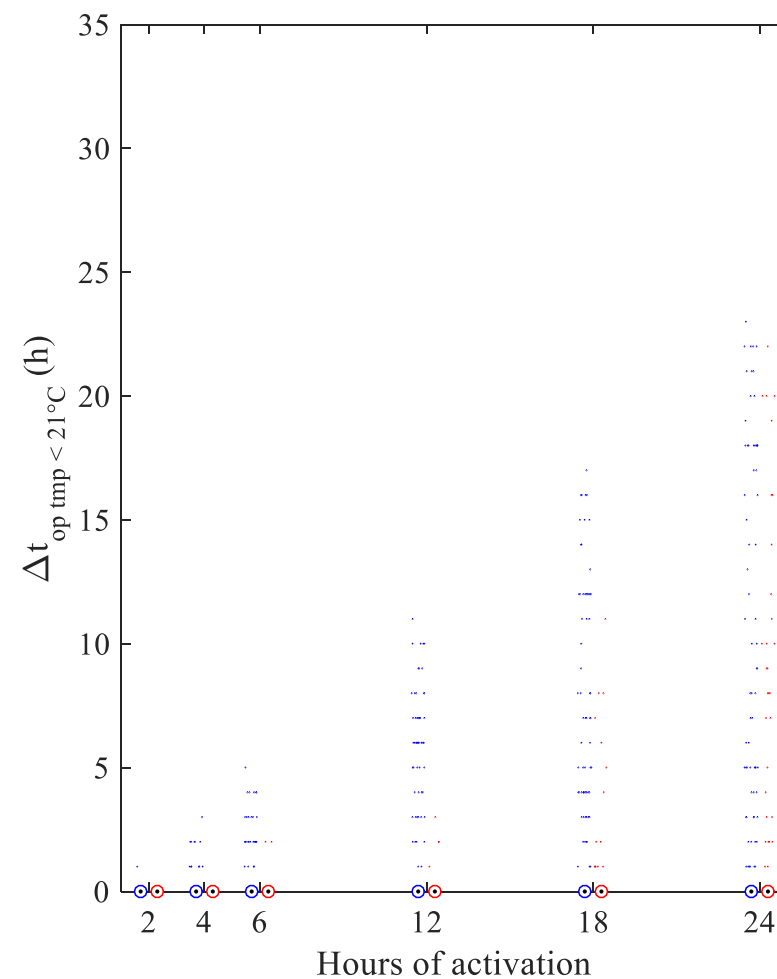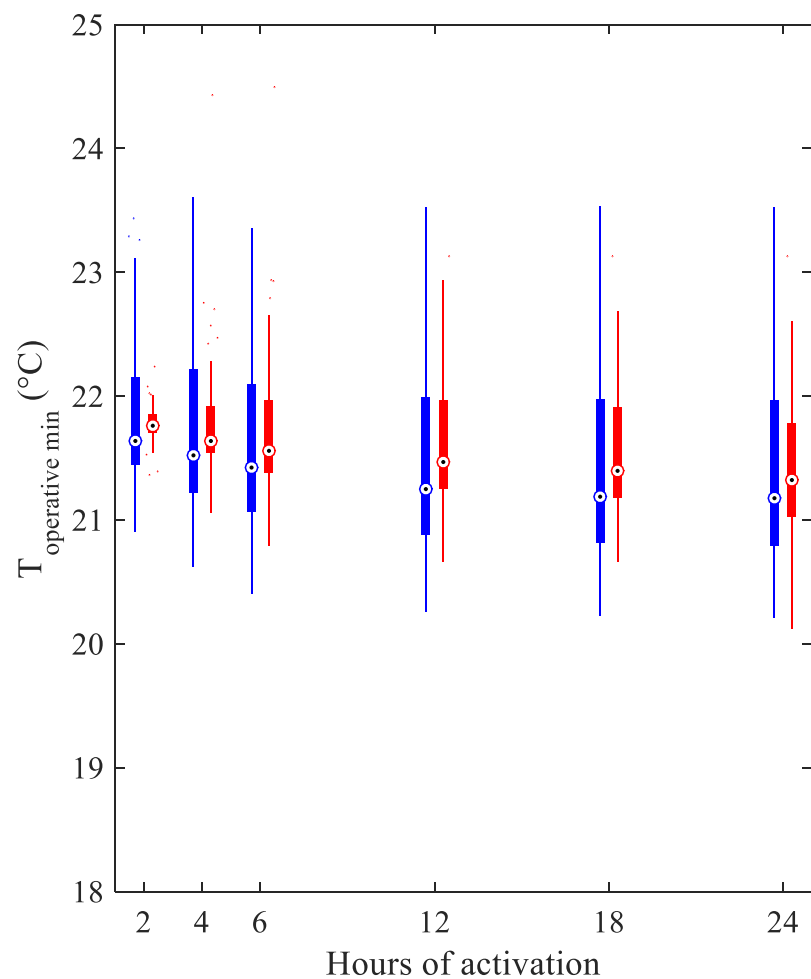

How to perform the activation in practise?

From the primary circuit



Weather-compensation
(emitters with valves or TRV
with large P-band)

Home automation systems



From the emitter




Control of digital thermostatic valve



AALBORG UNIVERSITY
DENMARK

Grid / Building interaction

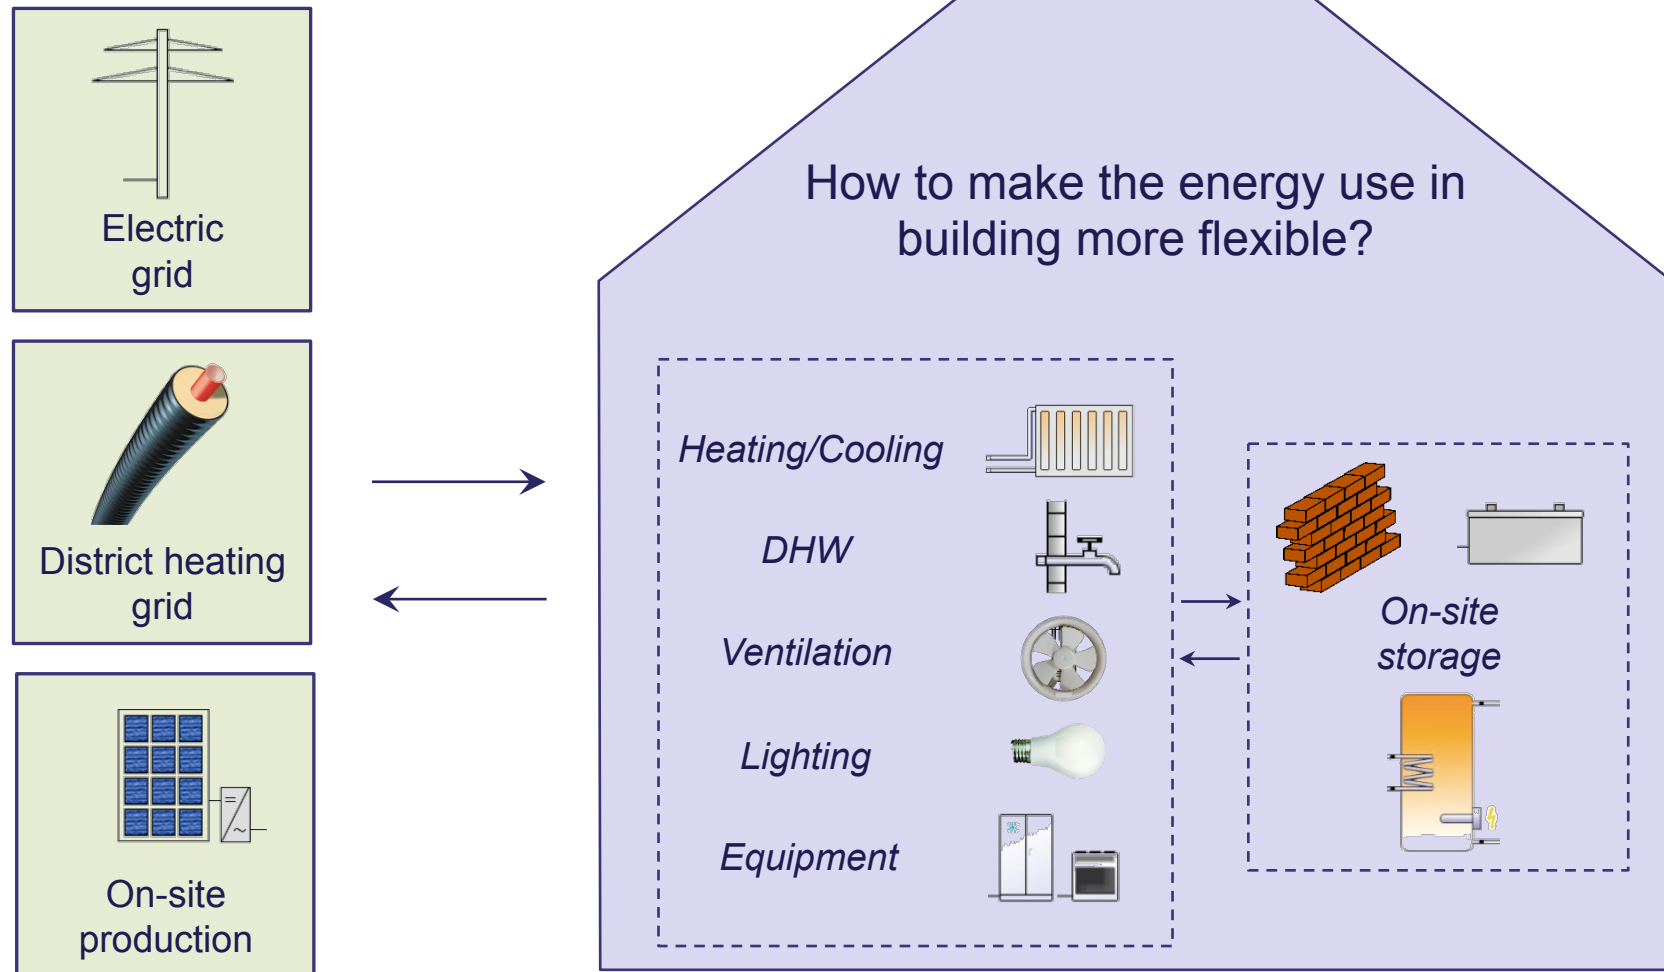

Pictures: Polysun