


# Intelligent Energy Systems Integration

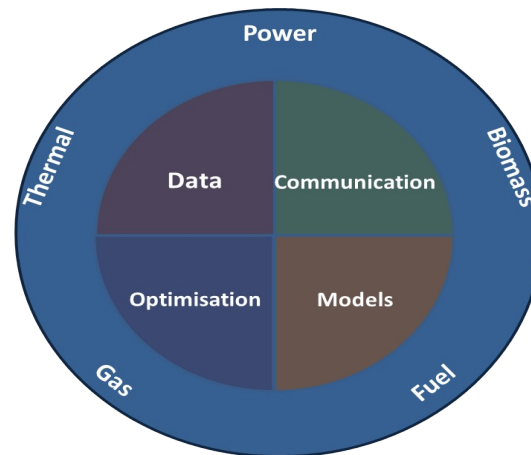

**Henrik Madsen, DTU Compute**

<http://www.henrikmadsen.org>

<http://www.smart-cities-centre.org>

Quote by B. Obama:  
(U.N. Climate Change Summit,  
New York, Sept. 2014)

*We are the **first generation**  
affected by climate changes,  
and we are the **last generation**  
able to do something about it!*




# Potentials and Challenges for renewable energy

- **Scenario:** We want to cover the worlds entire need for power using wind power.
- How large an area should be covered by wind turbines?



# Potentials and Challenges for renewable energy


- Scenario:** We want to cover the worlds entire need for power using wind power
- How large an area should be covered by wind turbines?
- Conclusion:** Use intelligence ....
- Calls for **IT / Big Data / Smart Energy Solutions/ Energy Systems Integration**

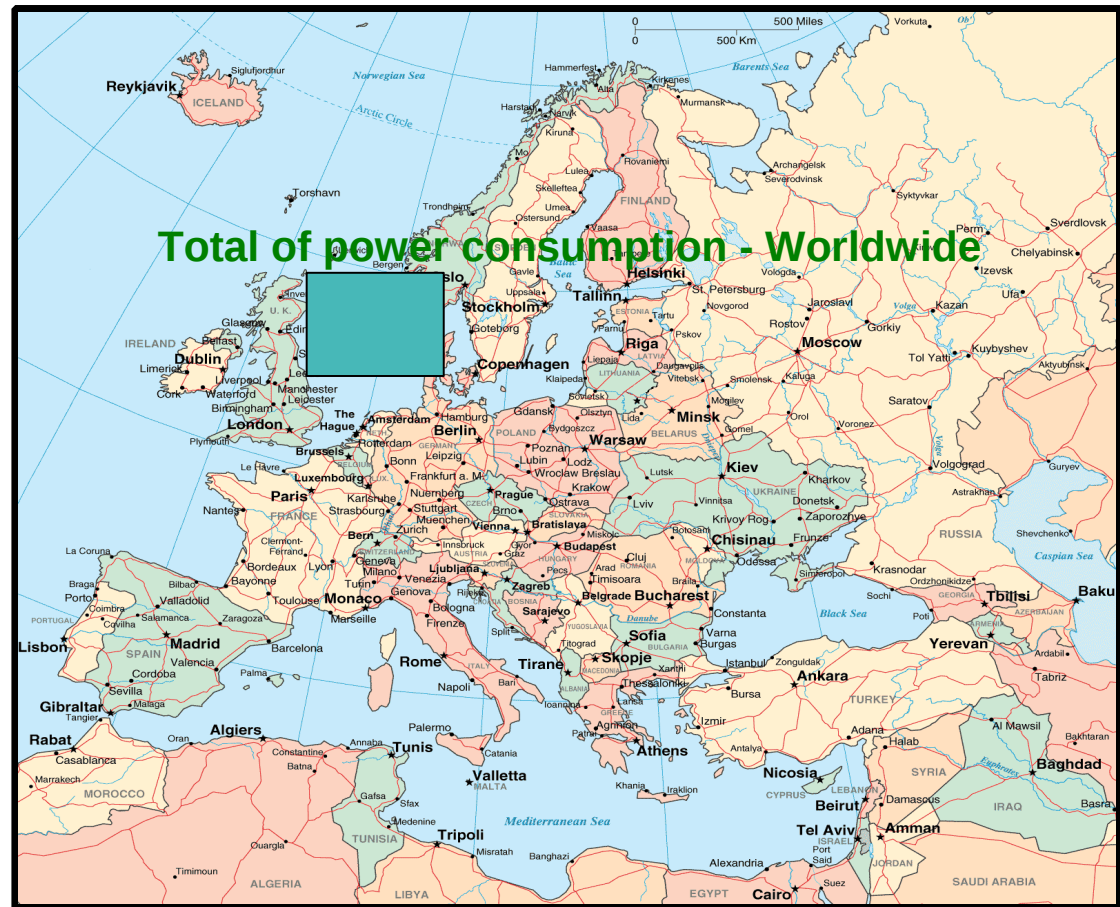

# The Danish Wind Power Case


.... balancing of the power system

25 % wind energy (West Denmark January 2008)

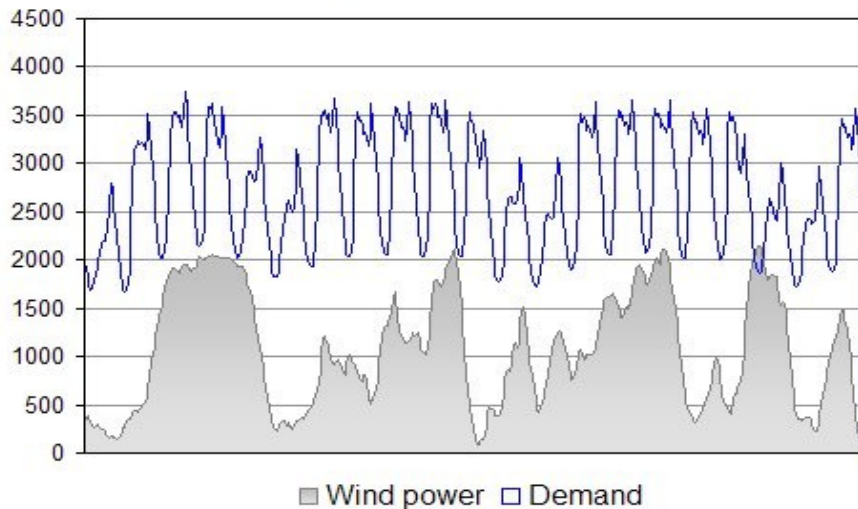

In 2008 wind power did cover the entire demand of electricity in 200 hours (West DK)

50 % wind energy

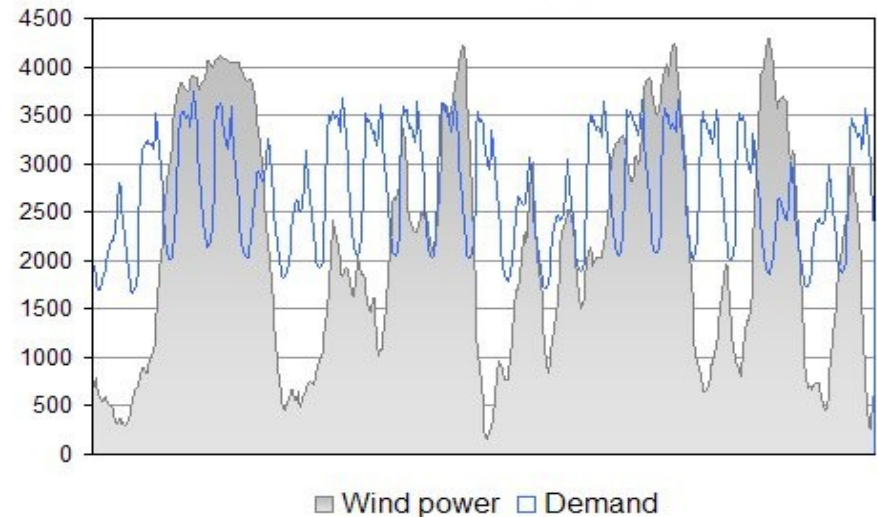

**In 2014 more than 40 pct of electricity load was covered by wind power.**


For several days in 2014 the wind power production was more than 120 pct of the power load.

July 10th, 2015 more than 140 pct of the power load was covered by wind power



# From large central plants to Combined Heat and Power (CHP) production

1980

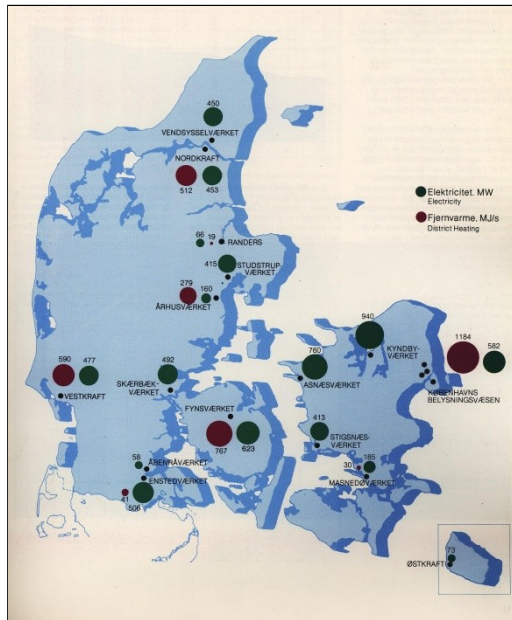


Today



*From a few big power plants to many small **combined heat and power** plants – however most of them based on coal*

# Control and Optimization

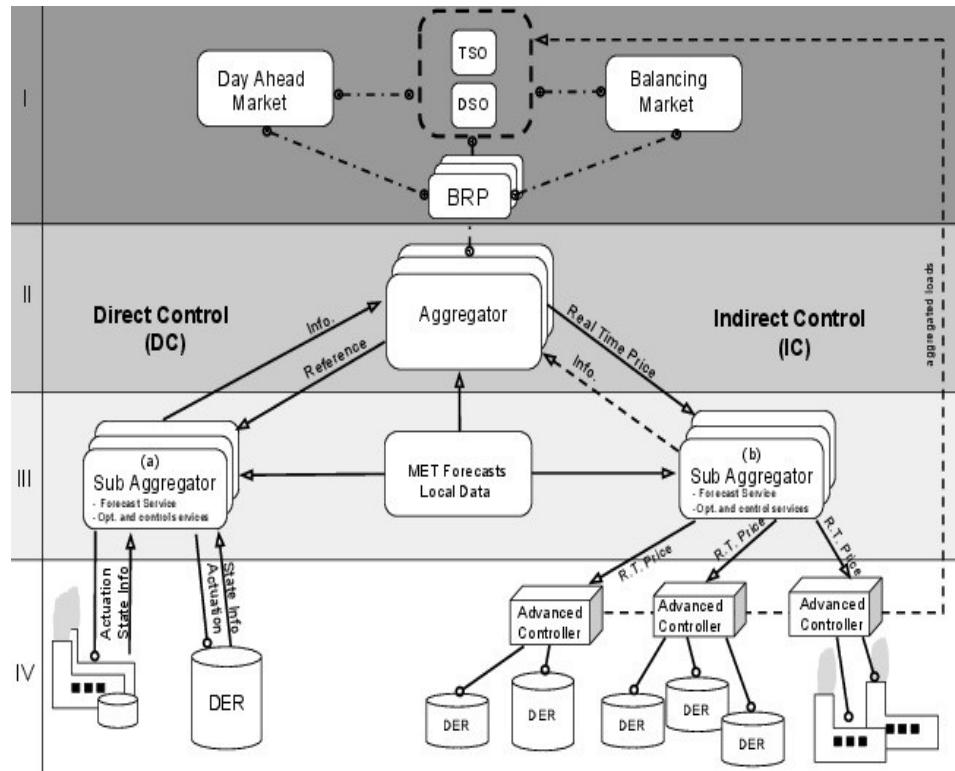

In New Wiley Book: Control of Electric Loads in Future Electric Energy Systems, 2015

## Day Ahead:

Stoch. Programming based on eg. Scenarios

Cost: Related to the market (one or two levels)

## Direct Control:

Actuator: **Power**

Two-way communication

Models for DERs are needed

Constraints for the DERs (calls for state est.)

Contracts are complicated

## Indirect Control:

Actuator: **Price**

Cost: E-MPC at **low (DER) level**, One-way communication

Models for DERs are not needed



Simple 'contracts'

# Forecasting is Essential

## Tools for Forecasting:

- Power load
- Heat load
- Gas load
- Prices (power, etc)
- Wind power prod.
- Solar power prod.

**Our tools wind and solar power forecasting are installed in Australia at AEMO (Australian Energy Market Operator)**

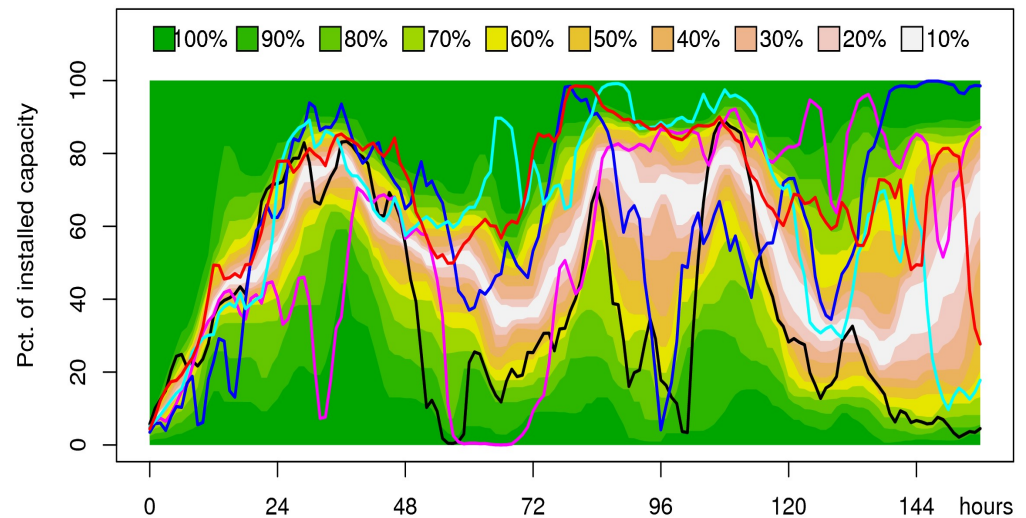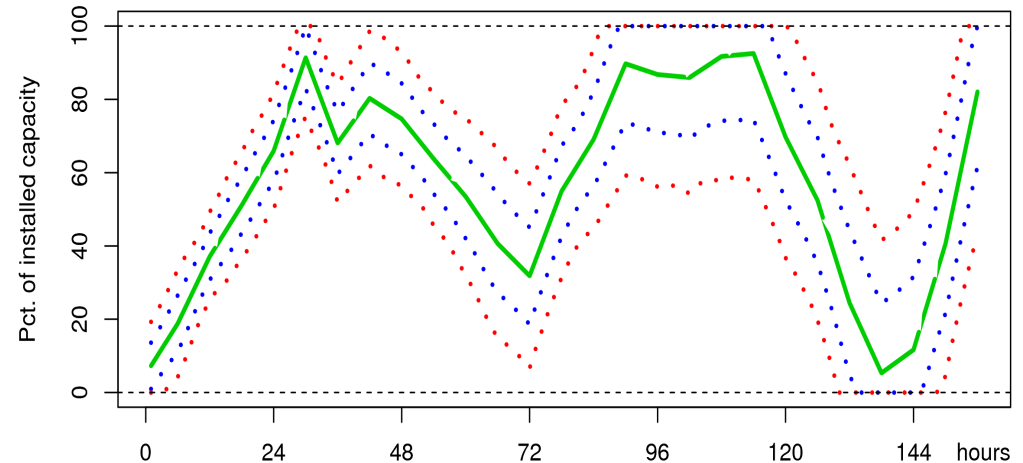




# ESI Idea

The **central idea of ESI** is that by **intelligently integrating** currently distinct energy flows (heat, power, gas and biomass) in we can enable very large shares of renewables, and consequently obtain substantial reductions in CO<sub>2</sub> emissions.

**Intelligent integration** will (for instance) enable lossless **virtual storage on a number of different time scales**.

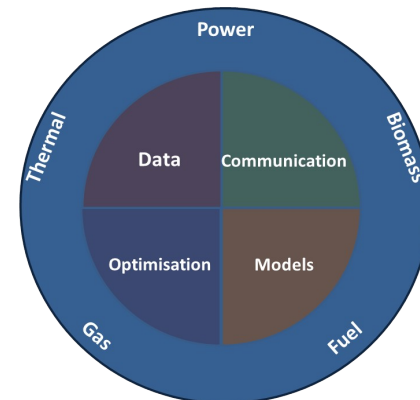

# ESI Solutions and CITIES


The **Center for IT-Intelligent Energy Systems in Cities (CITIES)** is aiming at establishing methodologies and solutions for design and operation of integrated electrical, thermal, fuel pathways at all scales.

CITIES is the largest Smart Cities and ESI research project in Denmark – see <http://www.smart-cities-centre.org> .




# ESI Concepts

**Energy Systems Integration** using **data and ICT solutions** leading to **models and methods** for **planning and operation** of future electric energy systems.

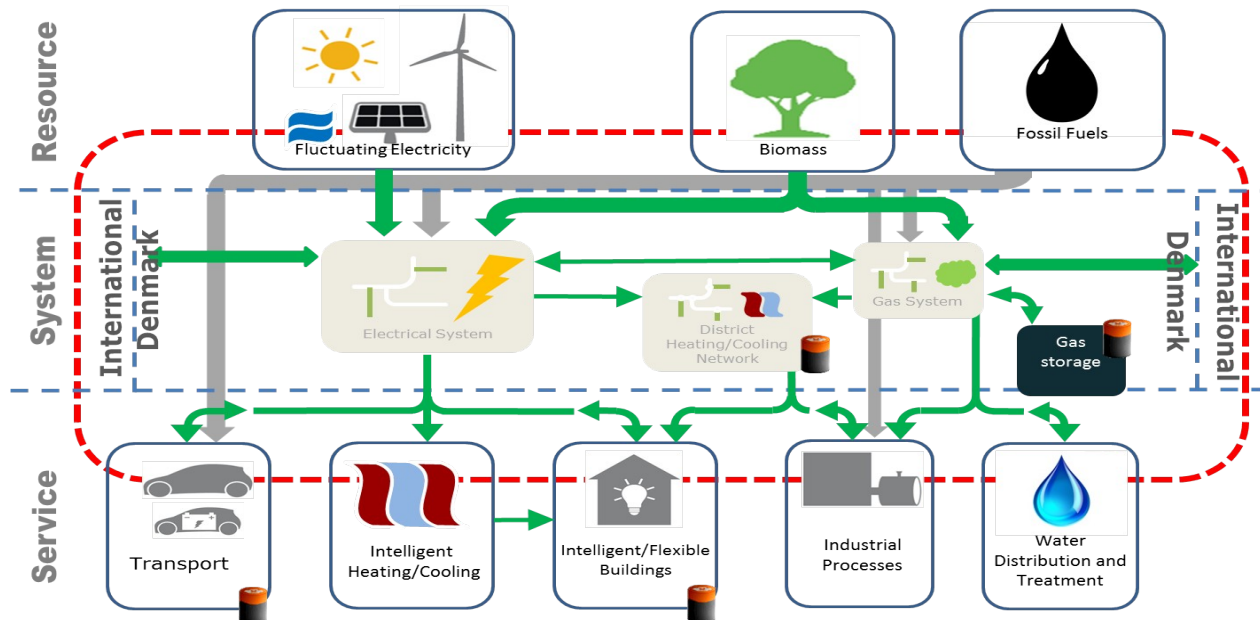

# Virtual Storage by Energy Systems Integration

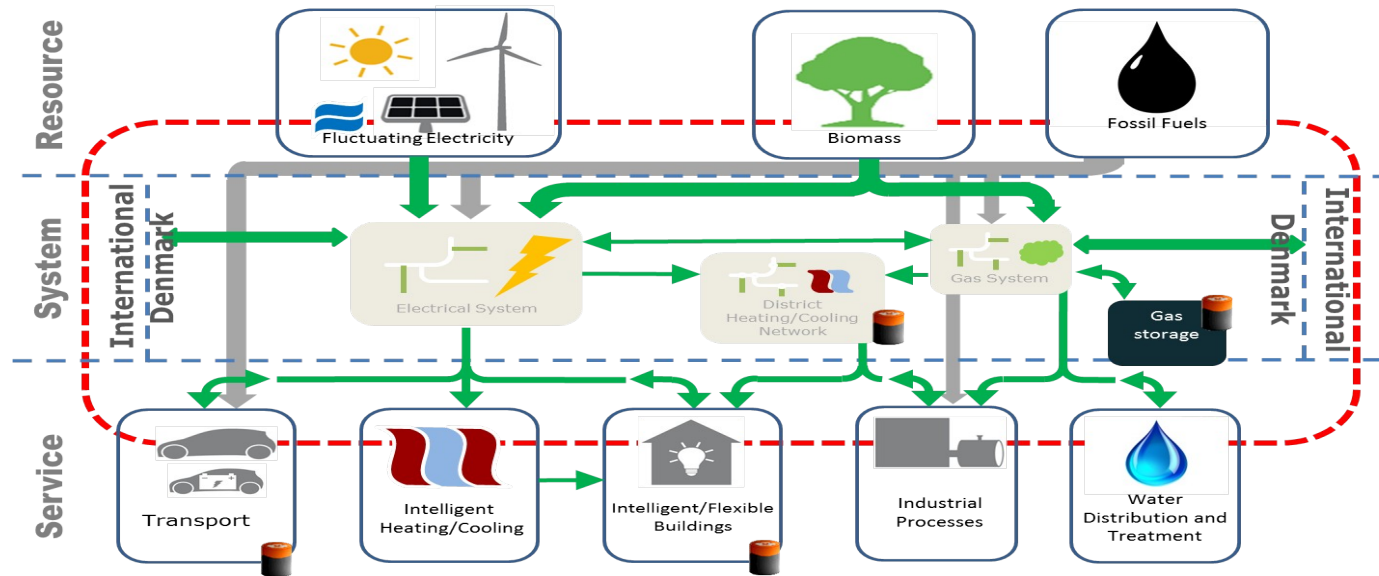


● **Denmark (2014) : 48 pct of power load by renewables (> 100 pct for some days in January)**

● **(Virtual) storage principles:**

- Buildings can provide storage up to, say, 5-12 hours ahead
- District heating/cooling systems can provide storage up to 1-3 days ahead
- Gas systems can provide seasonal storage

# Integration of Energy Systems

(Paradigmatic example - Denmark)

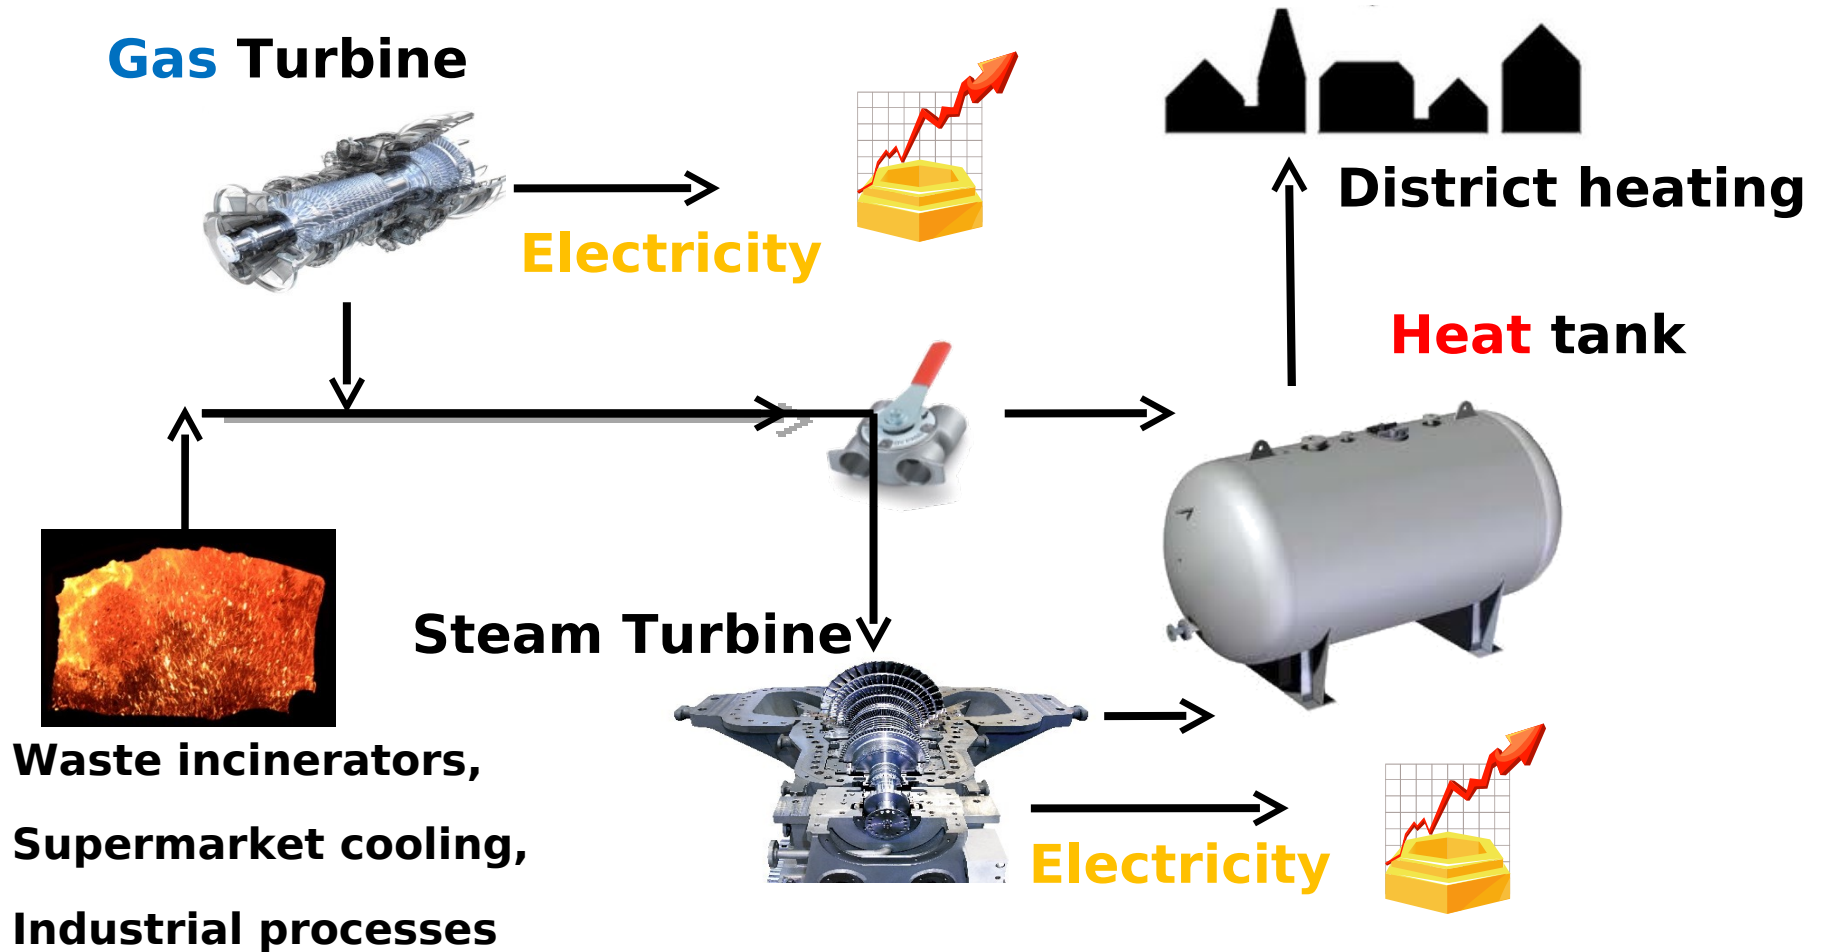



## Case study


# Control of Power Consumption (DSM) using the Thermal Mass of Buildings



# Data from BPA


## Olympic Peninsula project

- 27 houses during one year
- Flexible appliances: HVAC, cloth dryers and water boilers
- 5-min prices, 15-min consumption
- Objective: limit max consumption

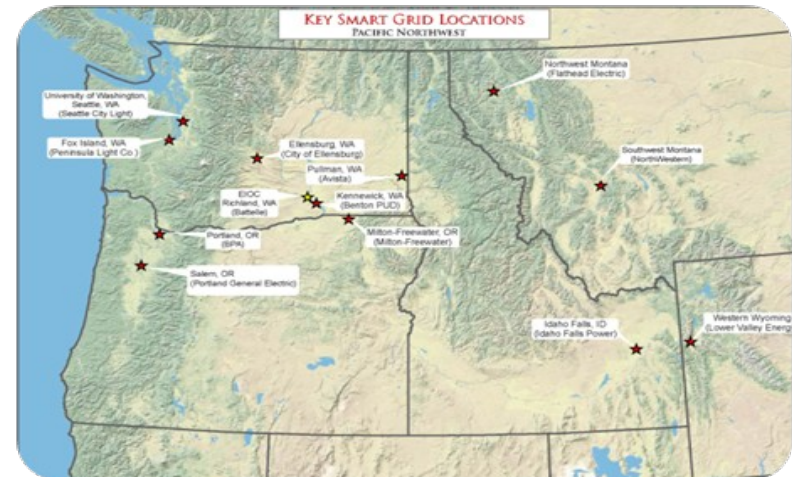


# Price responsiveness

*Flexibility is activated by adjusting the temperature reference (setpoint)*

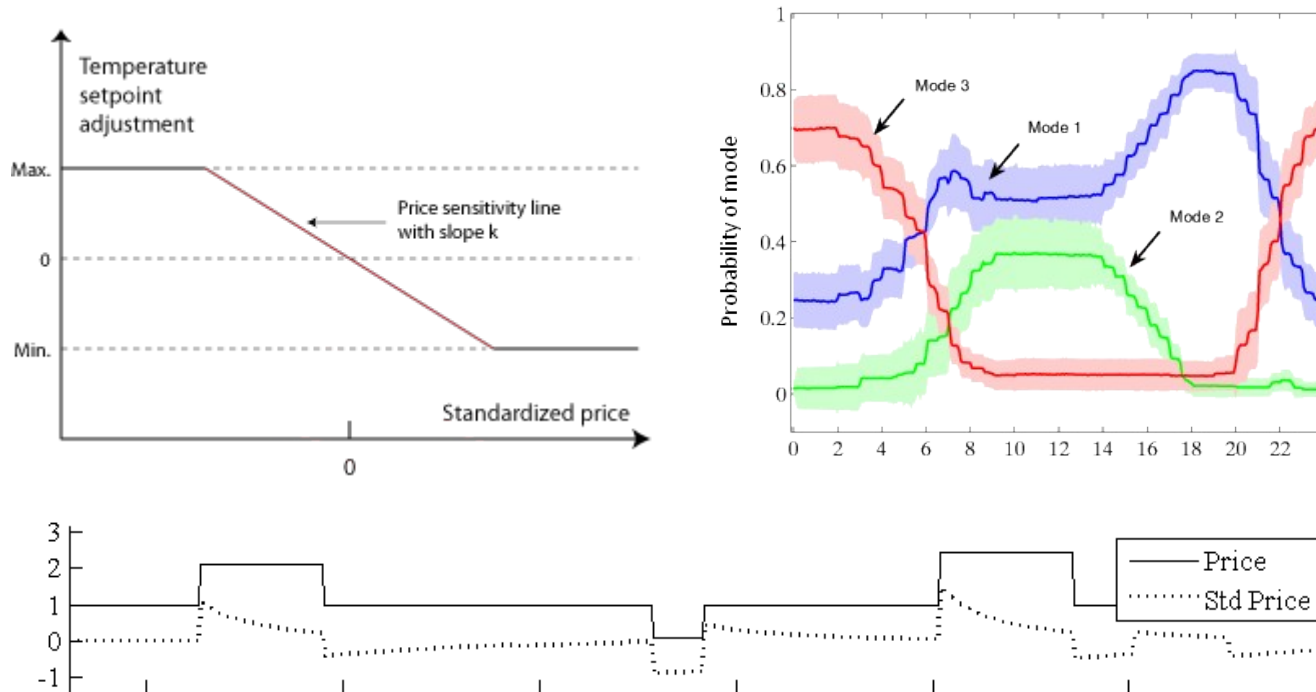


- **Standardized price** is the % of change from a price reference, computed as a mean of past prices with exponentially decaying weights.
- **Occupancy mode** contains a price sensitivity with its related comfort boundaries. 3 different modes of the household are identified (work, home, night)

# Aggregation (over 20 houses)

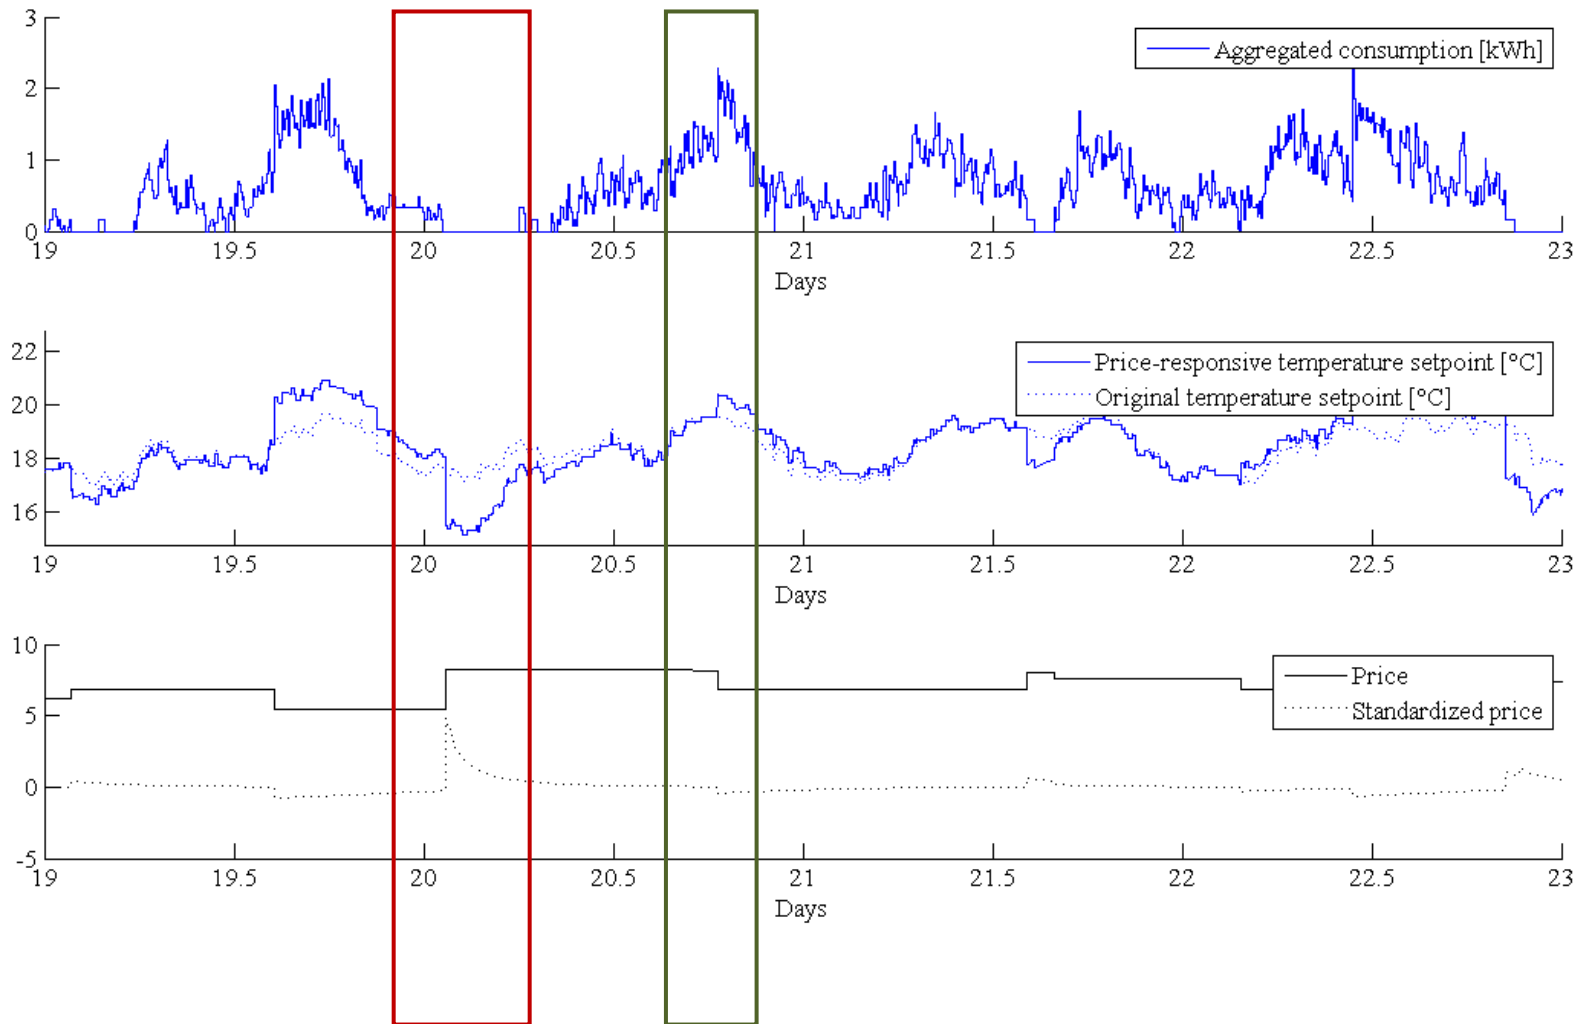


# Response on Price Step Change

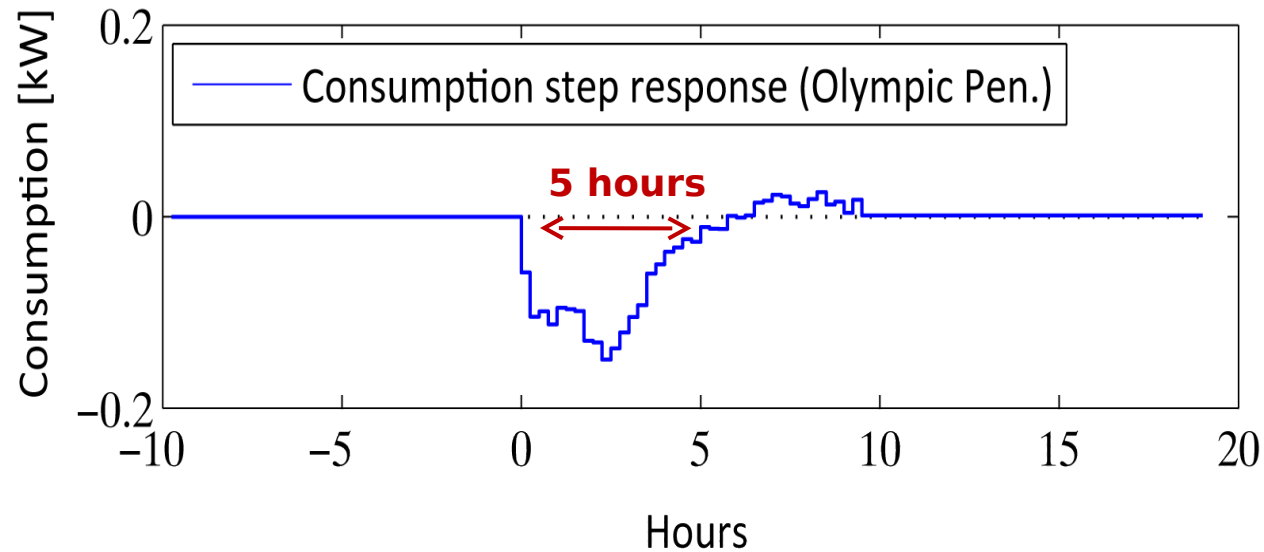




# Control of Power Consumption

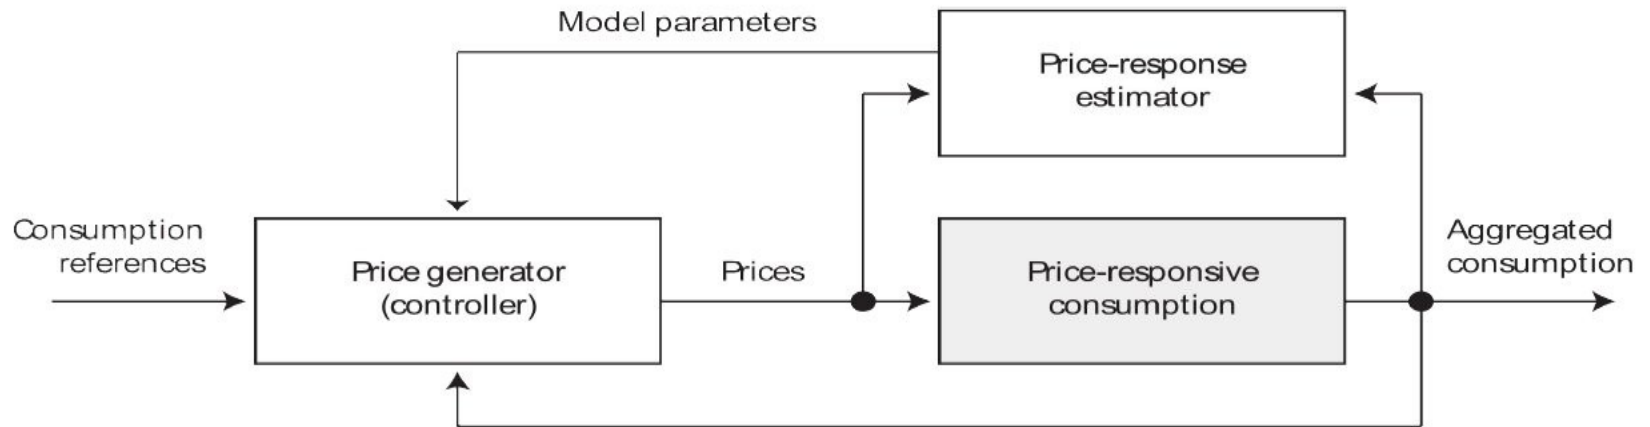

# Control performance

Considerable **reduction in peak consumption**

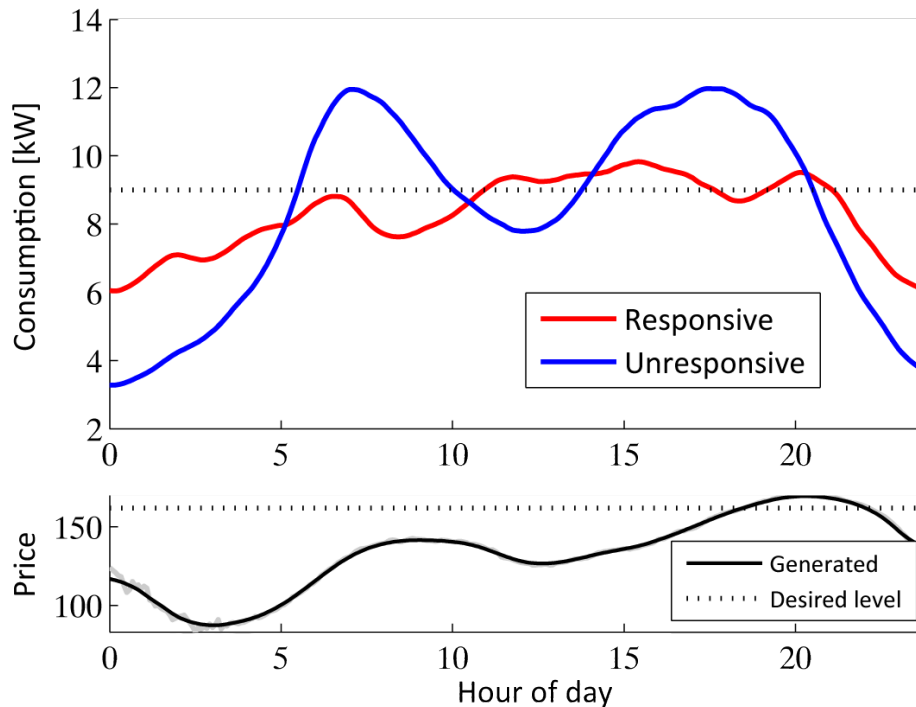

## Case study

# Control of Wastewater Treatment Plants




# Waste-2-Energy

Resources

WWTP Energy Hub

Energy service

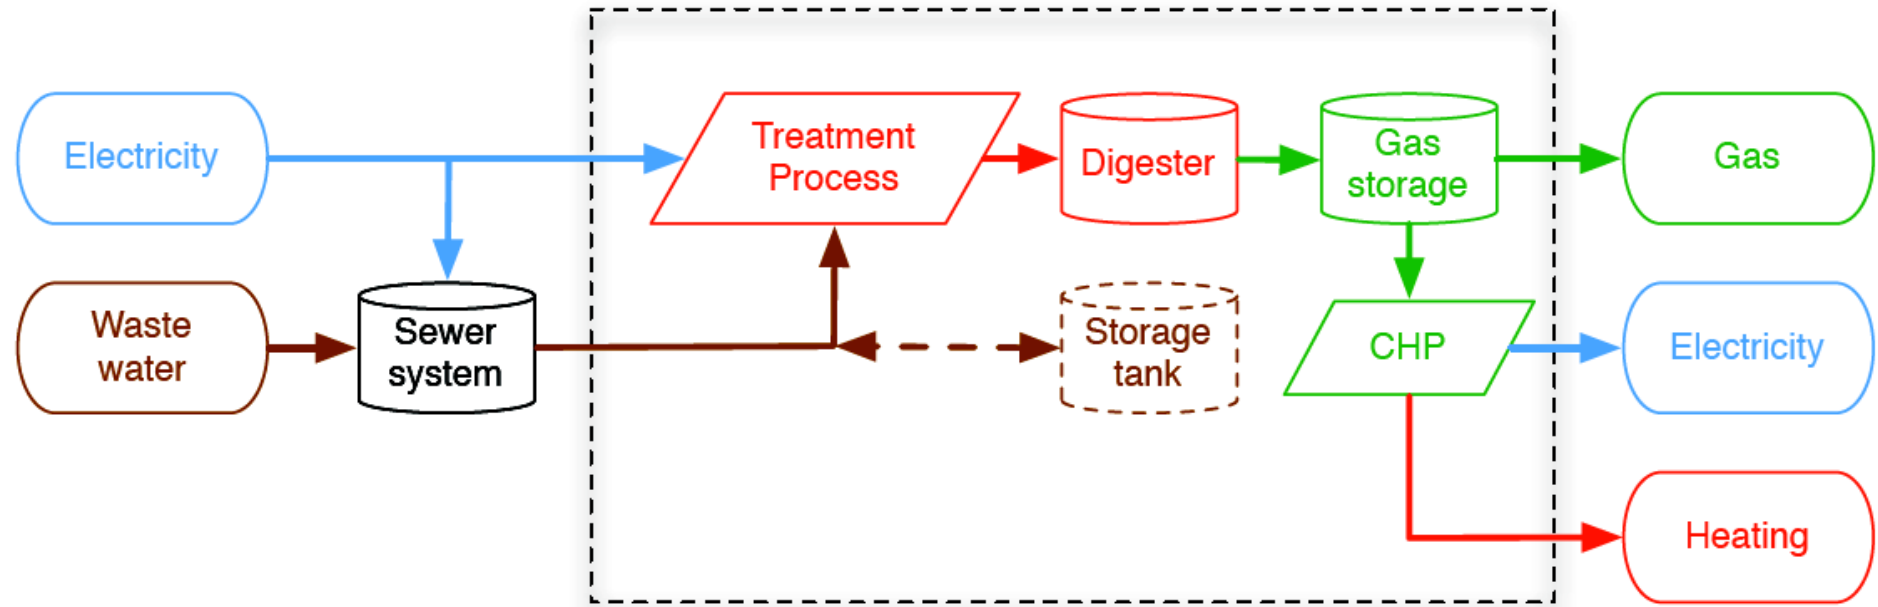

# Energy Flexibility in Wastewater Treatment

- **Sludge -> Biogas -> Gas turbine -> Electricity**
- **Power management of the aeration process**
- **Pumps and storage in sewer system**

## **Overall goals:**


**Cost reduction**

**Minimize effluent concentration**

**Minimize overflow risk**




# WWTP Control Architecture

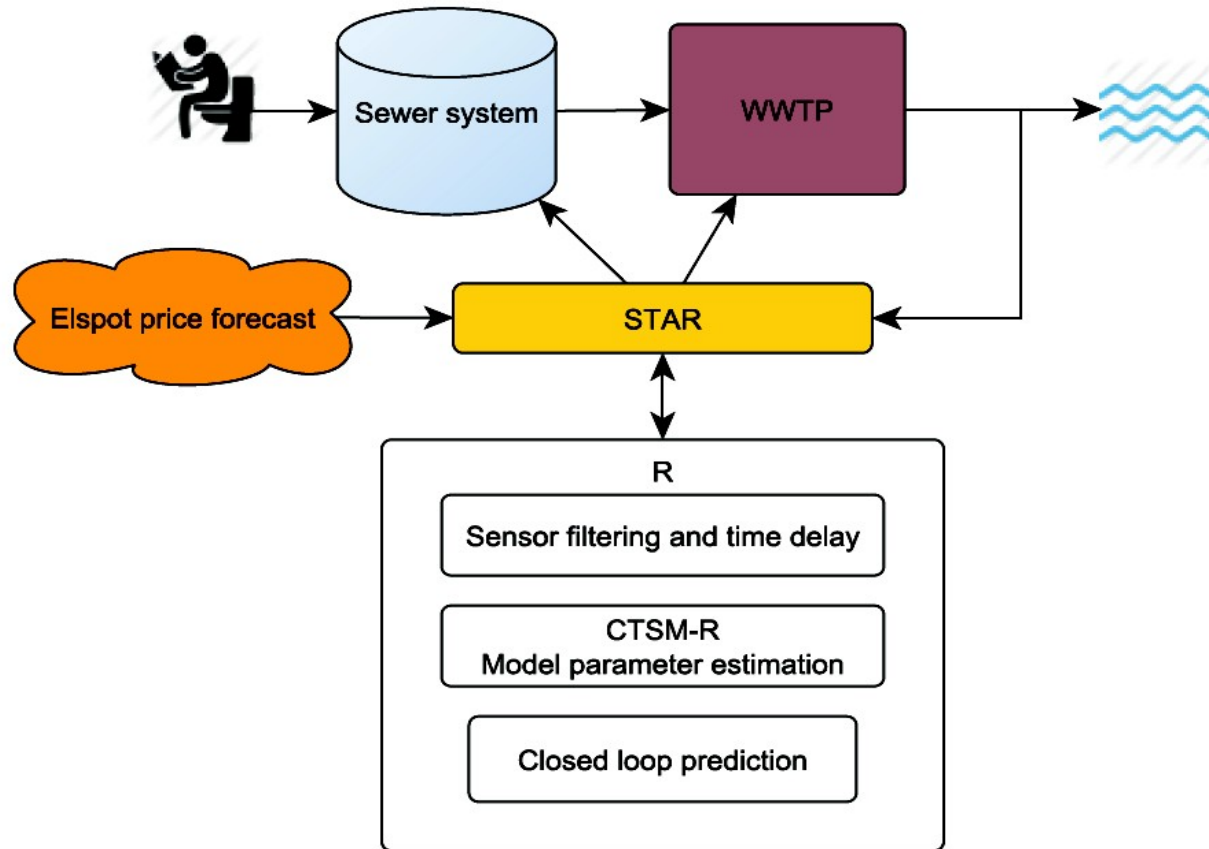

# International Alliances on Energy Systems Integration



# Proposal (UCD, DTU, KU Leuven): **ESI Joint Program as a part of European Research (EERA)**

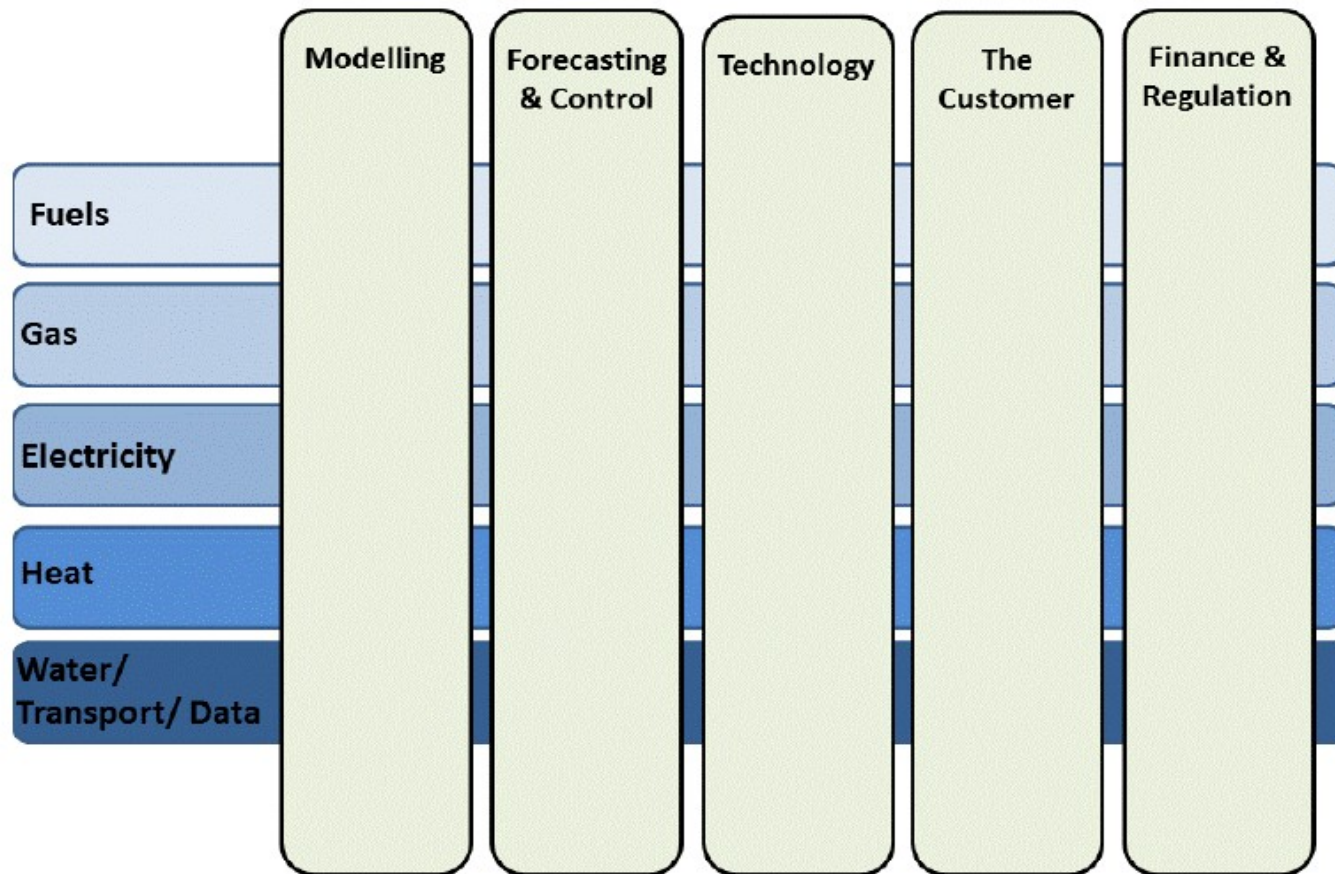



International Institute<sup>TM</sup>  
for Energy Systems  
Integration

## Addressing energy challenges through global collaboration



**Vision:** A global community of scholars and practitioners from leading institutes engaged in efforts to enable highly integrated, flexible, clean, and efficient energy systems

**Objectives:** Share ESI knowledge and Experience:  
Coordination of R&D activities:  
Education and Training  
Resources

### Activities 2014

- Feb 18-19 Workshop (Washington)
- May 28-29 Workshop (Copenhagen)
- July 21 – 25, ESI 101 (Denver)
- Nov 17th Workshop (Kyoto)

### Activities 2015

- Dublin, Denver, Leuven, Seoul



# Conclusion

- **Energy Systems Integration can provide virtual and lossless storage solutions (so maybe we should put less focus on physical storage solutions)**
- **Energy Systems Integration might be able to solve many of the problems Europe now is trying to solve by Super Grids (some of these huge investments might not be needed)**
- **Europe should put less focus on super-grids - I assume that ESI can solve a major part of the issues (the planned investments are huge - and maybe we don't need them)**
- **Focus on zero emission buildings - and less on zero energy buildings (the same holds supermarkets, wastewater treatment plants, etc.)**
- **District heating (or cooling) provide virtual storage on the essential time scale (up to a few days)**
- **We see a large potential in Demand Side Management. Automatic solutions and end-user focus is important**
- **We see a large potential in coupling cooling (eg. for comfort) and heating systems using DH networks**
- **We see large problems with the tax and tariff structures in many countries (eg Denmark). Coupling to prices for carbon capture could be advantageous.**
- **Markets and pricing principles need to be reconsidered; we see an advantage of having a physical link to the mechanism (eg. nodal pricing, capacity markets)**